

MAKING MODERN LIVING POSSIBLE



# Operating Instructions

## VLT® DeviceNet Converter MCA 194

### VLT® AutomationDrive FC 302 • VLT® 5000



[www.danfoss.com/drives](http://www.danfoss.com/drives)

**VLT**®  
THE REAL DRIVE



## Contents

<b>1 Introduction</b>	3
1.1 Purpose of the Manual	3
1.2 Additional Resources	3
1.3 Product Overview	3
1.4 Constraints	3
1.4.1 Software Versions	3
1.4.2 Relations	3
1.4.3 Hardware	4
1.4.4 Performance	5
1.5 Abbreviations	5
<b>2 Safety</b>	6
2.1 Safety Symbols	6
2.2 Qualified Personnel	6
2.3 Safety Precautions	6
<b>3 Installation</b>	8
3.1 Connecting the Bus Line	8
3.2 Mechanical Installation	8
3.3 EMC Precautions	10
<b>4 Commissioning</b>	11
4.1 Configure the DeviceNet Network	11
4.1.1 Setting the DeviceNet Address using the Hardware Switches	11
4.1.2 Setting the DeviceNet Address via 10-02 MAC ID	11
4.1.3 Start-up	12
4.2 LED Behaviour	12
4.3 Initialisation	13
<b>5 Parameter Mapping Lists</b>	14
5.1 VLT® 5000 Parameter Group 0	14
5.2 VLT® 5000 Parameter Group 1	16
5.3 VLT® 5000 Parameter Group 2	19
5.4 VLT® 5000 Parameter Group 3	22
5.5 VLT® 5000 Parameter Group 4	30
5.6 VLT® 5000 Parameter Group 5	35
5.7 VLT® 5000 Parameter Group 6	37
5.8 VLT® 5000 Parameter Group 7	39
5.9 VLT® 5000 Parameter Group 8	40
5.10 VLT® 5000 Parameter Group 9	41

<b>6 Troubleshooting</b>	43
6.1 Step-by-step Troubleshooting	43
<b>Index</b>	44

# 1 Introduction

## 1.1 Purpose of the Manual

These Operating Instructions provide information for installing and configuring the DeviceNet Converter option MCA 194. The Operating Instructions also contain the parameter mapping lists and troubleshooting information.

First-time users can find the most essential information for quick installation and set-up in:

- *Chapter 1.3 Product Overview*
- *Chapter 1.4 Constraints*
- *Chapter 3 Installation*

For more detailed information including the full range of set-up options and diagnosis tools, refer to:

- *Chapter 4 Commissioning*
- *Chapter 5 Parameter Mapping Lists*

VLT® is a registered trademark.

## 1.2 Additional Resources

The following literature is available for the FC 300 series:

- VLT® AutomationDrive Operating Instructions
- VLT® AutomationDrive Design Guide
- VLT® AutomationDrive Programming Guide

Supplementary publications and manuals are available for download. See [www.danfoss.com/BusinessAreas/DrivesSolutions/Documentations/VLT+Technical+Documentation.htm](http://www.danfoss.com/BusinessAreas/DrivesSolutions/Documentations/VLT+Technical+Documentation.htm) for listings.

## 1.3 Product Overview

The MCA 194 DeviceNet Converter is a DeviceNet option when installed in VLT® AutomationDrive FC 302. It emulates the DeviceNet commands of a VLT® 5000 in a DeviceNet network.

With this DeviceNet converter option the FC 302 reacts as a VLT® 5000 on the DeviceNet network. Changes to PLC programming or re-configuration are normally not necessary.

The FC 302 identifies itself as a VLT® 5000 on the DeviceNet network. For example, a write command to ramp-up time in VLT® 5000 is automatically linked to the corresponding ramp-up time parameter in VLT® AutomationDrive FC 302.

## **NOTICE**

Some parameters in the VLT® 5000 are not supported in the FC 302 and some FC 302 parameters cannot be accessed via the DeviceNet converter option MCA 194. Refer to *chapter 5 Parameter Mapping Lists* for more information. If a write request is attempted to a parameter selection not supported, the frequency converter discards the value and issues a positive reply. Only parameters and functions described in this manual are supported.

## **NOTICE**

The replacement frequency converter must match the power size of the motor for optimal performance. In some cases a bigger frequency converter may be needed to replace the VLT® 5000. Make sure that the brake resistor matches the new frequency converter. Make sure that the new frequency converter meets the local regulations concerning the machinery directive, prefuses, and other appropriate regulations.

## **NOTICE**

Observe local rules and regulations when replacing frequency converter in existing installations.

## 1.4 Constraints

### 1.4.1 Software Versions

- VLT® AutomationDrive FC 302 with firmware version 6.54 or higher.
- The MCA 194 DeviceNet Converter firmware is based on a VLT® 5000 software version 3.9x and DeviceNet software version 2.x.

### 1.4.2 Relations

This manual relates to the following hardware:

- VLT® DeviceNet Converter option MCA 194, type no. 130B5601
- VLT® General I/O option MCB 101, type no. 130B1125 (uncoated), 130B1212 (coated)
- VLT® External 24 Volt DC Supply MCB 107, type no. 130B1108 (uncoated), 130B1208 (coated)

### 1.4.3 Hardware

- The VLT® DeviceNet Converter MCA 194 supports VLT® AutomationDrive FC 302 only.
- The FC 302 has fewer digital I/Os and analog output signals than VLT® 5000. The General I/O Option MCB 101 must be mounted in the FC 302 to map these signals and utilise all I/Os.

VLT® 5000		FC 302	
Terminal	Function	Terminal	Function
16	Digital input	X30/2 <sup>1)</sup>	Digital input
17	Digital input	X3/3 <sup>1)</sup>	Digital input
18	Digital input	18	Digital input
19	Digital input	19	Digital input
27	Digital input	27	Digital input
29	Digital input	29	Digital input
32	Digital input	32	Digital input
33	Digital input	33	Digital input
20	GND Digital input	20	GND Digital input
53	Analog input voltage	53	Analog input voltage <sup>2)</sup>
54	Analog input voltage	X30/11 <sup>3)</sup>	Analog input voltage
60	Analog input current	54	Analog input current <sup>3)</sup>
55	GND analog/digital input voltage	55	GND analog/digital input voltage
42	Analog/digital output	42	Analog output 0/4-20 mA
		X30/6 <sup>1)</sup>	Digital output
		X30/7 <sup>1)</sup>	Pulse output
39	GND analog/digital output	39	GND analog /digital output
04-05	Relay	04-06	Relay
01-03	Relay	01-03	Relay
68	RS-485-P	68	RS-485-P
69	RS-485-N	69	RS-485-N
61	GND RS-485	61	GND RS-485
12	24 V out	12	24 V out
13	24 V out	13	24 V out
50	10 V out	50	10 V out

Table 1.1 Terminal Mapping

1) General I/O option MCB 101

2) Switch "S201" must be OFF

3) Switch "S202" must be ON

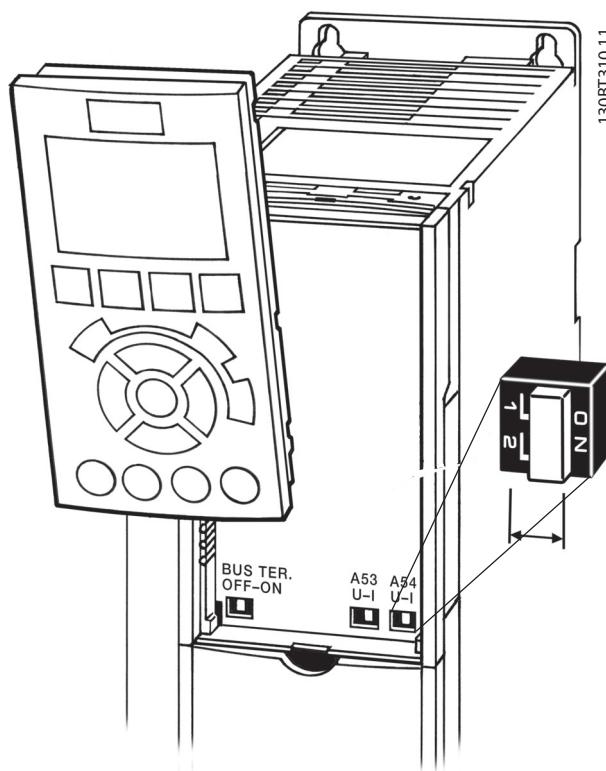


Illustration 1.1 Location of Switches S801, S201, and S202 (Left to Right)

#### 1.4.4 Performance

- The dynamic performance on the motor shaft in the closed loop operation compared with VLT® 5000 can be different in certain applications. If necessary, adjust the PID controller manually.
- The motor control algorithm of the VLT® AutomationDrive results in a better motor performance compared to VLT® 5000.

#### **NOTICE**

Factory values:

After initialisation, most parameters are set to match the factory settings of the VLT® 5000 parameters. For more information about the initialisation, see the *VLT® AutomationDrive FC 301/FC 302 Programming Guide*.

#### **NOTICE**

Linked Set-ups:

To synchronise set-up changes made with running motor, ensure that FC 302 set-ups are linked. This is done in 0-12 *This Set-up Linked to*.

#### 1.5 Abbreviations

AOC	Application Oriented Control
CTW	Control Word
EMC	Electromagnetic Compatibility
I/O	Input/Output
LED	Light Emitting Diode
LSB	Least Significant Bit
MAV	Main Actual Value (actual output)
MOC	Motor Oriented Control
MSB	Most Significant Bit
MRV	Main Reference Value (Setpoint)
N/A	Not Applicable
PCD	Peripherals Communication Data (process data)
PCV	Parameter Characteristics Value (Parameter channel)
PLC	Programmable Logic Controller
PNU	Parameter Number
PU	Power Unit
REF	Reference (= MRV)
STW	Status Word

Table 1.2 Abbreviations

## 2 Safety

### 2

#### 2.1 Safety Symbols

The following symbols are used in this document:

##### **WARNING**

Indicates a potentially hazardous situation which could result in death or serious injury.

##### **CAUTION**

Indicates a potentially hazardous situation which could result in minor or moderate injury. It may also be used to alert against unsafe practices.

##### **NOTICE**

Indicates important information, including situations that may result in damage to equipment or property.

#### 2.2 Qualified Personnel

Correct and reliable transport, storage, installation, operation and maintenance are required for the trouble-free and safe operation of the frequency converter. Only qualified personnel is allowed to install or operate this equipment.

Qualified personnel is defined as trained staff, who are authorised to install, commission, and maintain equipment, systems and circuits in accordance with pertinent laws and regulations. Additionally, the personnel must be familiar with the instructions and safety measures described in this document.

#### 2.3 Safety Precautions

##### **WARNING**

###### **HIGH VOLTAGE**

Frequency converters contain high voltage when connected to AC mains input power. Failure to perform installation, start-up, and maintenance by qualified personnel could result in death or serious injury.

- Installation, start-up, and maintenance must be performed by qualified personnel only.

###### **Safety regulations**

1. The frequency converter must be disconnected from mains, if repair work is to be carried out. Check that the mains supply has been disconnected and that the necessary time has passed

before removing motor and mains plugs, see *Table 2.1*.

2. The [Off] key does not disconnect the equipment from mains and is thus not to be used as a safety switch.
3. Establish correct protective earthing of the equipment, protect the user against supply voltage, and protect the motor against overload in accordance with applicable national and local regulations.
4. The earth leakage currents are higher than 3.5 mA.
5. Protection against motor overload is not included in the factory setting. If this function is desired, set *1-90 Motor Thermal Protection [4] ETR trip or [3] ETR warning*.

##### **NOTICE**

The function is initialised at  $1.16 \times$  rated motor current and rated motor frequency. For the North American market, the ETR functions provide class 20 motor overload protection in accordance with NEC.

6. Do not remove the plugs for the motor and mains supply while the frequency converter is connected to mains. Check that the mains supply has been disconnected and that the necessary time has passed before removing motor and mains plugs, see *Table 2.1*.
7. The frequency converter has more voltage inputs than L1, L2 and L3, when load sharing (linking of DC intermediate circuit) and external 24 V DC have been installed. Check that all voltage inputs have been disconnected and that the necessary time has passed before commencing repair work, see *Table 2.1*.

###### **Warning against unintended start**

1. The motor can be brought to a stop with digital commands, bus commands, references or a local stop, while the frequency converter is connected to mains. These stop functions are not sufficient to prevent unintended starts.
2. While parameters are being changed, the motor may start. Consequently, always press [Off].
3. A motor that has been stopped may start if faults occur in the electronics of the frequency converter, or if a temporary overload or a fault in the supply mains or the motor connection ceases.

**WARNING**

Touching the electrical parts may be fatal - even after the equipment has been disconnected from mains.

2

Voltage [V]	Minimum waiting time (minutes)	
	4	15
200-240	0.25-3.7 kW	5.5-37 kW
380-480	0.25-7.5 kW	11-75 kW
525-600	0.75-7.5 kW	11-75 kW
525-690		11-75 kW

High voltage may be present even when the warning LED indicator lights are off.

Table 2.1 Discharge Time

Also make sure that other voltage inputs have been disconnected, such as external 24 V DC, load sharing (linkage of DC intermediate circuit), as well as the motor connection for kinetic back-up.

## 3 Installation

### 3.1 Connecting the Bus Line

Terminate the bus line at both ends of each segment. A mismatch of impedance may result in reflections on the line resulting in corrupt data transmission.

The DeviceNet Option Card contains a suitable termination. To activate the termination, turn on *Switch 1* on the DeviceNet converter option. By default, the switch is turned off.

#### **NOTICE**

Notice that pin numbers are colour-coded on the DeviceNet connector.

Unlike the VLT® 5000, the FC 302 DeviceNet connectors are colour-coded to avoid swapping the bus wires.

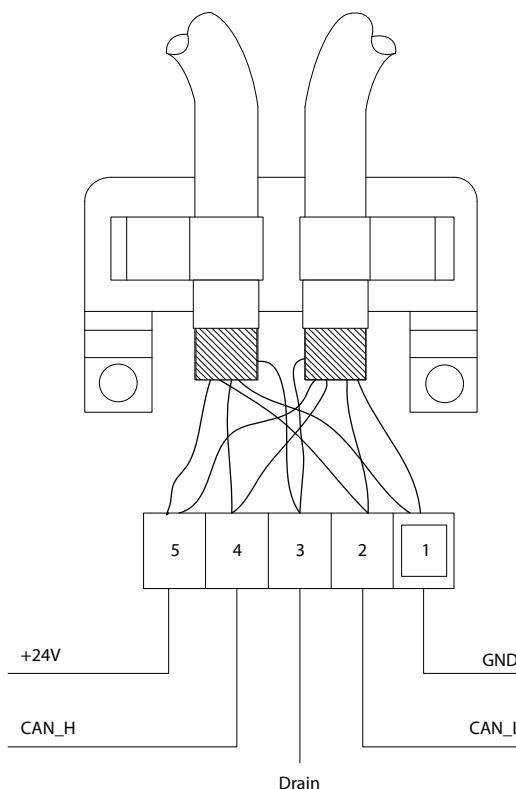



Illustration 3.1 Connecting Wires to VLT DeviceNet Converter  
MCA 194

Pin no.	Terminal	Colour	Name
1	V-	Black	GND
2	CAN_L	Blue	CAN LOW
3	Drain	(bare)	Screen
4	CAN_H	White	CAN HIGH
5	V+	Red	+24 V

Table 3.1 Correct Colour-Coding

### 3.2 Mechanical Installation

#### 3.2.1 Mount the Option

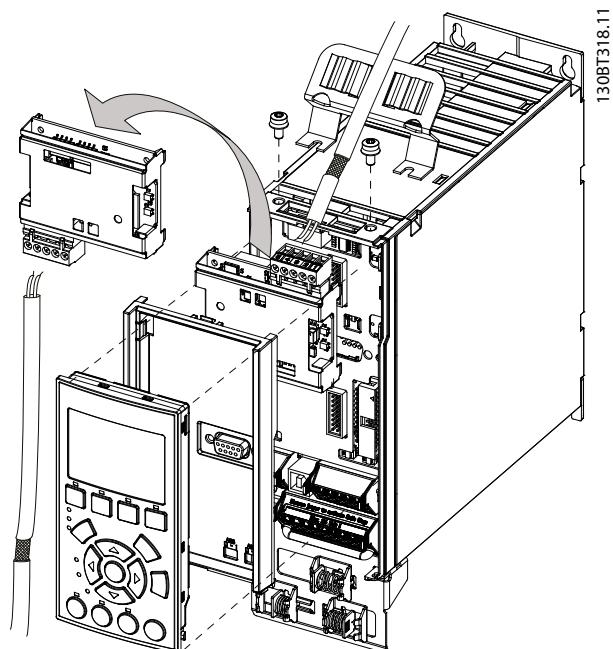

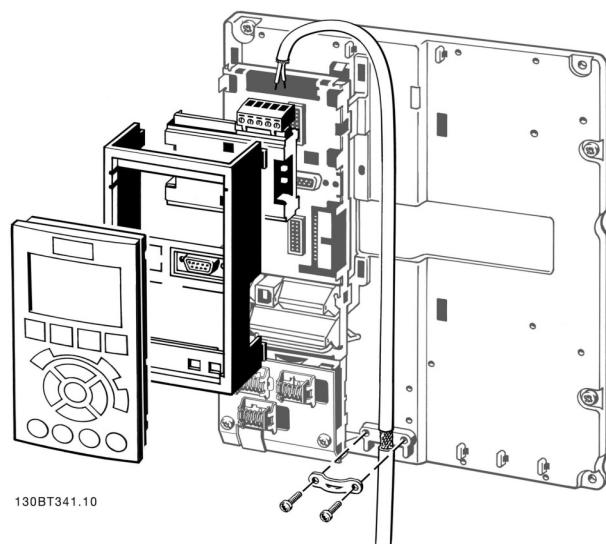


Illustration 3.3 Cable Holders

1. Remove the LCP from the FC 302.
2. Remove the frame below the LCP.
3. Push the option into place. 2 positions are possible, with cable terminal facing either up or down. The cable up position is often most suitable when several frequency converters are installed side-by-side in a rack, as this position permits shorter cable lengths.
4. Push the fieldbus option adaptor frame for the FC 302 into place.
5. Remount the LCP.
6. Attach the cable.
7. Fasten the cable using cable holders.

3

### 3.2.2 Adapter Plate

To ease the replacement of VLT 5000 with VLT® AutomationDrive, there is a number of adapter plates available. The adapter plates have the same footprints as VLT 5000 and have threaded holes for VLT® AutomationDrive. The adapter plate prevents damage that can occur from drilling new threaded holes in the backboard of the enclosure. The adapter plate also decreases the time required to exchange a broken frequency converter.

The following mechanical adapter plates are available:

Ordering number	Style	Height [mm]	Width [mm]	Type
130B0183	Bookstyle, IP20	395	90	5001-5003 200-240 V 5001-5005 380-500 V
130B0184	Bookstyle, IP20	395	130	5004-5006 200-240 V 5006-5011 380-500 V
130B0185	Compact, IP20	395	220	5001-5003 200-240 V 5001-5005 380-500 V 5004-5006 200-240 V 5006-5011 380-500 V 5001-5011 550-600 V

Table 3.2 Ordering Numbers for Adapter Plates

### 3.3 EMC Precautions

To achieve interference-free operation of the DeviceNet:

- Maintain high distance (min. 200 mm [8"]) between the DeviceNet communication cable and the motor and brake resistor cables to avoid coupling of high frequency noise from one cable to the other.
- When crossing is unavoidable, ensure that the DeviceNet cable crosses motor and brake resistor cables at an angle of 90°.

#### **NOTICE**

Observe relevant national and local regulations, for example regarding protective earth connection.

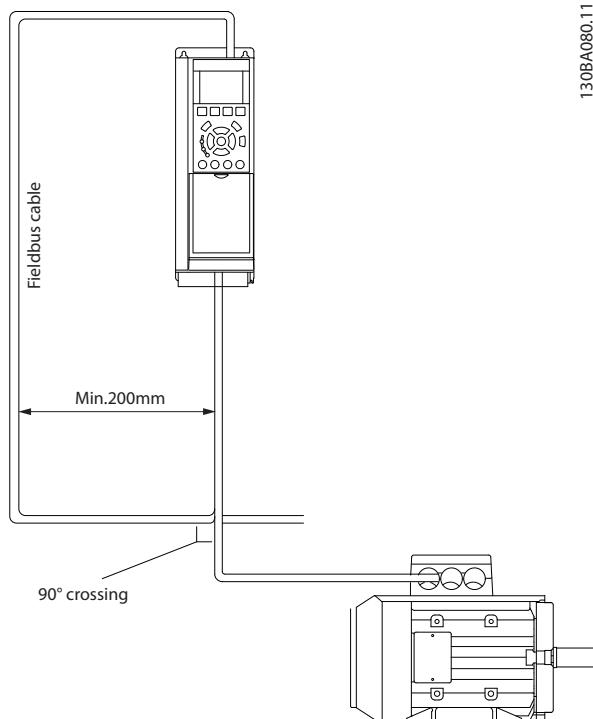


Illustration 3.4 Correct EMC Installation

## 4 Commissioning

### 4.1 Configure the DeviceNet Network

All DeviceNet stations connected to the same bus network must have a unique station address.

Before a VLT® 5000 can be replaced with an FC 302 with MCA 194, only the station address and baud rate needs to be configured in the FC 302.

The DeviceNet address of the FC 302 can be selected via:

- Hardware switches
- Parameter 10-02 MAC ID (default 63)
- Class code 0X03, Instance 1, Attribute 1

#### **NOTICE**

After installing DeviceNet Converter MCA 194, check that 8-02 Control Source is set to [3] Option A.

#### 4.1.1 Setting the DeviceNet Address using the Hardware Switches

Read the hardware switches during power-up. When switches are changed, perform a power down-up immediately to activate the changes.

#### **NOTICE**

The address change comes into effect at the next power-up, and can be read in 10-02 MAC ID.

Using the hardware switches, select an address range from 0 to 63 (factory setting 63) according to *Illustration 4.1: ON = 1, OFF = 0*

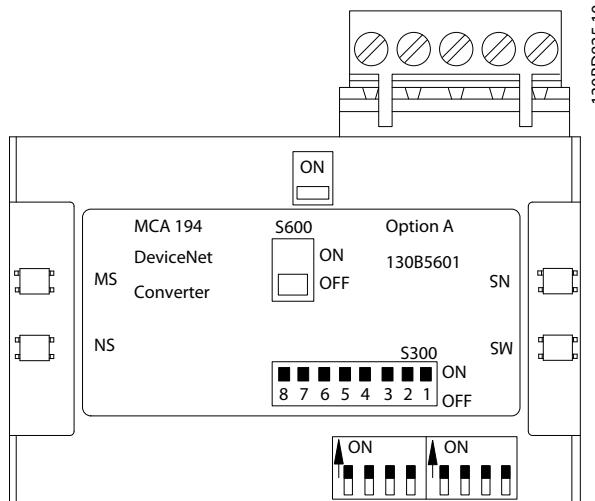


Illustration 4.1 DeviceNet Converter Option A

130BD825.10  
4

Switch	VLT® 5000								FC 302							
	1	2	3	4	5	6	7	8	8	7	6	5	4	3	2	1
Address	+32	+16	+8	+4	+2	+1	-	-	-	-	+32	+16	+8	+4	+2	+1
Example:																
1	0	0	0	0	0	1	-	-	-	-	0	0	0	0	0	1
35	1	0	0	0	1	1	-	-	-	-	1	0	0	0	1	1
52	1	1	0	1	0	0	-	-	-	-	1	1	0	1	0	0

Table 4.1 Hardware Switches

#### 4.1.2 Setting the DeviceNet Address via 10-02 MAC ID

Setting the address via parameter 10-02 MAC ID or the DeviceNet Class code 0X03, Instance 1, Attribute 1, is possible, if the hardware switches are all set in the "On" position. The new address becomes active at the next power-up.

#### 4.1.3 Start-up

After setting the station address from VLT® 5000 to VLT® AutomationDrive, cycle power on the frequency converter to activate the new address. The master/PLC now recognises the frequency converter as VLT® 5000. A solid green NS LED on the MCA 194 option indicates that

communication between the master and the frequency converter is established. If the NS LED flashes, the master/PLC has not recognised the frequency converter.

For more information, refer to *chapter 6.1 Step-by-step Troubleshooting*.

## 4

#### 4.2 LED Behaviour

The option has 2 bi-coloured LEDs, as shown in *Table 4.2*. The status of the LEDs is shown in *Table 4.3* and *Table 4.4*.

LED label	Description
NS	Network Status
MS	Module Status (DP-V1 communication)

**Table 4.2 Bi Coloured LEDs**

State	Bi-colour LED	Status
No Power	Off	There is no power applied to the option
Device operational	Green	The DeviceNet option is operating in normal condition.
Standby	Green	The DeviceNet option needs commissioning due to configuration missing, incomplete or incorrect.
Minor fault	Red	Recoverable fault.
Unrecoverable fault	Red	Unrecoverable fault, may need replacing.
Self test	Green Red	The DeviceNet option is in Self-test mode.

**Table 4.3 LED: Module Status (MS)**

State	Bi-colour LED	Status
No Power/Not on-line	Off	The option has not completed "Duplicate MAC ID" test yet or may not be powered.
On-line, not connected	Green	The option is on-line, but not allocated to a master.
On-line and connected	Green	The DeviceNet option is on-line and connected to a master.
Connection time-out	Red	One or more I/O connections are in time-out state.
Critical link failure	Red	

**Table 4.4 LED: Network Status (NS)**

#### **NOTICE**

The LED status patterns of the MCA 194 are not compatible with the patterns of the VLT® 5000 DeviceNet LEDs.

### 4.3 Initialisation

To achieve the best performance, initialise the frequency converter after the option is mounted. If the frequency converter is delivered from factory with the option installed, skip this step. The initialisation is done via 14-22 *Operation Mode* or a 3-finger reset. The parameters of the FC 302 are set to factory values, and a number of FC 302 parameters are set to values that match the VLT® 5000 initial values.

Factory copy via VLT® 5000 parameter 006 is supported and initialises the FC 302 and also set it to the VLT® 5000 default settings.

Table 4.5 lists the parameter settings created during initialisation.

Parameter	Initialisation setting
0-02 Motor Speed Unit	[Hz]
1-52 Min Speed Normal Magnetising [Hz]	1.0 Hz
3-16 Reference 2 Source	[0] No function
4-12 Motor Speed Low Limit [Hz]	132.0 Hz
3-00 Reference Range	min – max
3-01 Reference/Feedback Unit	[1] %
3-11 Jog Speed [Hz]	10.0 Hz
4-30 Motor Feedback Loss Function	[0] Disabled
4-56 Warning Feedback Low	-4000000
4-57 Warning Feedback High	4000000
6-10 Terminal 53 Low Voltage	0.00 Volt
6-20 Terminal 54 Low Voltage	0.00 Volt
6-22 Terminal 54 Low Current	0.00 Volt
5-51 Term. 29 High Frequency	5000 Hz
5-56 Term. 33 High Frequency	25000 Hz
4-32 Motor Feedback Loss Timeout	1.00 s
14-21 Automatic Restart Time	5 s
14-03 Overmodulation	[0] Off
20-93 PID Proportional Gain	0.01
8-54 Reversing Select	[0] Digital input
8-90 Bus Jog 1 Speed	300 RPM
8-91 Bus Jog 2 Speed	300 RPM
7-04 Speed PID Differentiation Time	OFF
2-10 Brake Function	[0] Off
2-17 Over-voltage Control	[0] Off
5-40 Function Relay	[22] Ready, no thermal Warning
5-41 On Delay, Relay	[23] Remote, ready, no TW
7-09 Speed PID Error Correction w/ Ramp	100000 (max)
14-11 Mains Voltage at Mains Fault	calculated value: VLT5000 level = FC 302 level * 1,35 / sqrt(2)
<b>MCB 101 option specific parameters</b>	
5-16 Terminal X30/2 Digital Input	[1] Reset
5-17 Terminal X30/3 Digital Input	[19] Freeze reference
<b>PROFIBUS specific parameters</b>	
9-71 Profibus Save Data Values	[1] Store all setups

Table 4.5 Parameter Set-up at Initialisation

## 5 Parameter Mapping Lists

### 5.1 VLT® 5000 Parameter Group 0

	VLT 5000 series	FC 302 series
Parameter	001 Language select	0-01 Language
Options	[0] English	[0] English
[1] Deutsch	[1] Deutsch	
[2] French	[2] French	
[3] Dansk	[3] Dansk	
[4] Spanish	[4] Spanish	
[5] Italian	[5] Italian	

Table 5.1 Conversion of Parameter 001

	VLT 5000 series	FC 302 series
Parameter	002 Local/remote control	Not converted
Options	[0] Remote	
[1] Local with External Stop		
[2] Local		

Table 5.2 Conversion of Parameter 002

	VLT 5000 series	FC 302 series
Parameter	003 Local reference	Not converted

Table 5.3 Conversion of Parameter 003

	VLT 5000 series	FC 302 series
Parameter	004 Active Set-up	0-10 Active Set-up
Options	[0] Factory Setup	[0] Factory Setup
[1] Setup 1	[1] Setup 1	
[2] Setup 2	[2] Setup 2	
[3] Setup 3	[3] Setup 3	
[4] Setup 4	[4] Setup 4	
[5] Multi Setup	[9] Multi Setup	

Table 5.4 Conversion of Parameter 004

	VLT 5000 series	FC 302 series
Parameter	005 Setup Copy	0-51 Set-up Copy
Options	[0] Factory Set-up	[0] Factory Set-up
[1] Setup 1	[1] Setup 1	
[2] Setup 2	[2] Setup 2	
[3] Setup 3	[3] Setup 3	
[4] Setup 4	[4] Setup 4	
[5] Active Setup	[9] Active Setup	

Table 5.5 Conversion of Parameter 005

	VLT 5000 series	FC 302 series
Parameter	006 Setup Copy	0-51 Set-up Copy
Options	[0] No Copy	[0] No Copy
[1]	[1]	
[2]	[2]	
[3]	[3]	
[4]	[4]	

Table 5.6 Conversion of Parameter 006

	VLT 5000 series	FC 302 series
Parameter	007 LCP Copy	Not converted

Table 5.7 Conversion of Parameter 007

	VLT 5000 series	FC 302 series
Parameter	008 Display scaling of motor frequency	Not converted

Table 5.8 Conversion of Parameter 008

	VLT 5000 series	FC 302 series
Parameter number	009 Display line	0-23
Parameter number	010 Display line	0-20
Parameter number	011 Display line	0-21
Parameter number	012 Display line	0-22
Options	[0] None	[0] None
[1] Reference %	[1602] Reference %	
[2] Reference [Unit]	[1601] Reference [Unit]	
[3] Feedback [Unit]	[1652] Feedback [Unit]	
[4] Frequency [Hz]	[1613] Frequency [Hz]	
[5] Frequency x scale	[1609] Custom readout	
[6] Motor current [A]	[1614] Motor current [A]	
[7] Torque [%]	[1622] Torque [%]	
[8] Power [kW]	[1610] Power [kW]	
[9] Power [HP]	[1611] Power [HP]	
[10] Output energy [kWh]	[1502] kWh counter [kWh]	
[11] Motor voltage [V]	[1612] Motor voltage [V]	

Table 5.9 Conversion of Parameters 009 to 012

	VLT 5000 series	FC 302 series
Parameter number	009	0-09 Performance Monitor
Parameter number	010	0-10 Active Set-up
Parameter number	011	0-11 Programming Set-up
Parameter number	012	0-12 This Set-up Linked to
Options	[12] DC link voltage [V]	[1630] DC link voltage [V]
	[13] Thermal load, motor [%]	[1618] Thermal load, motor [%]
	[14] Thermal load, VLT® [%]	[1635] Inverter thermal [%]
	[15] Running hours [hours]	[1501] Running hours [hours]
	[16] Digital input	[1660] Digital input
	[17] Analogue input 53 [V]	[1662] Analogue input 53 [V]
	[18] Analogue input 54 [V]	[1664] Analogue input 54 [V]
	[19] Analogue input 60 [mA]	[1662] Analogue input 53 [mA]
	[20] Pulse reference [Hz]	[1651] Pulse reference [Hz]
	[21] Ext. reference [%]	[1650] Ext. reference [%]
	[22] Status word [hex]	[1603] Status word [hex]
	[23] Brake effect/2 min [kW]	[1633] Brake effect/2 min [kW]
	[24] Brake effect/sec [kW]	[1632] Brake effect/sec [kW]
	[25] Heat sink temp.	[1634] Heat sink temp.
	[26] Alarm word [hex]	
	[27] Control word [hex]	[1600] Control word [hex]
	[28] Warning word 1 [hex]	
	[29] Warning word 2 [hex]	
	[30] Com. Option warning [hex]	[953] Com. Option warning [hex]
	[31] RPM [min]	[1617] Speed RPM [min]
	[32] RPM x scaling [min]	[1609] Custom readout
	[33] LCP display text	Not possible

Table 5.10 Conversion of Parameters 009 to 012

	VLT 5000 series	FC 302 series
Parameter	013 Local Ctrl./config	Not converted

Table 5.11 Conversion of Parameter 013

	VLT 5000 series	FC 302 series
Parameter	014 Local Stop key	0-41 [Off] Key on LCP
Options	[0] Disable	[0] Disable
	[1] Enable	[1] Enable
		[2] Password

Table 5.12 Conversion of Parameter 014

	VLT 5000 series	FC 302 series
Parameter	015 Local Jogging	Not converted
Options	[0] Disable	
	[1] Enable	

Table 5.13 Conversion of Parameter 015

	VLT 5000 series	FC 302 series
Parameter	016 Local Reversing	Not converted
Options	[0] Disable	
	[1] Enable	

Table 5.14 Conversion of Parameter 016

	VLT 5000 series	FC 302 series
Parameter	017 Local Stop key	0-43 [Reset] Key on LCP
Options	[0] Disable	[0] Disable
	[1] Enable	[1] Enable
		[2] Password

Table 5.15 Conversion of Parameter 017

	VLT 5000 series	FC 302 series
Parameter	018 Lock for data change	0-61 Access to Main Menu w/o Password
Options	[0] Not locked	[0] Full access
	[1] Lock	[1] LCP: Read only

Table 5.16 Conversion of Parameter 018

	VLT 5000 series	FC 302 series
Parameter	019 Power-Up Mode	0-04 Operating State at Power-up
Options	[0] Auto Restart, use saved ref.	[0] Resume
	[1] Forced stop, use saved ref.	[1] Forced stop, use saved ref.
	[2] Forced stop, set ref = 0	[2] Forced stop, set ref = 0

Table 5.17 Conversion of Parameter 019

	VLT 5000 series	FC 302 series
Parameter	027 Warning readout line	Not converted
Options	[0] Warning in line 1/2	
	[1] Warning in line 3/4	

Table 5.18 Conversion of Parameter 027

5

## 5.2 VLT® 5000 Parameter Group 1

	VLT 5000 series	FC 302 series
Parameter	100 Configuration	0-02 1-01 Motor Control Principle
Options	[0] Speed control, open loop	Par. 1-00 = [0] Speed open loop Par. 1-01 = [1] VVC <sup>+</sup>
	[1] Speed control, closed loop	Par. 0-02 = [0] RPM Par. 1-00 = [1] Speed closed loop
	[3] Process control, closed loop	Par. 1-00 = [3] Process Par. 1-01 = [1] VVC <sup>+</sup>
	[4] Torque control, open loop	Par. 1-00 = [4] Torque open loop Par. 1-01 = [1] VVC <sup>+</sup>
	[5] Torque control, speed feedback	Par. 1-00 = [2] Torque close loop Par. 1-01 = [3] Flux with motor fb Par. 5-71 = [1] Counter clockwise

Table 5.19 Conversion of Parameter 100

	VLT 5000 series	FC 302 series
Parameter	101 Torque characteristic	1-03 Torque Characteristics 1-04 Overload Mode 14-40 VT Level
Options	[1] High constant torque	Par. 1-03 = [0] Constant torque Par. 1-04 Over load = [0] High
	[2] High variable torque low	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 45% Par. 1-04 Over load = [0] High
	[3] High variable torque medium	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 66% Par. 1-04 Over load = [0] High
	[4] High variable torque high	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 85% Par. 1-04 Over load = [0] High
	[5] High special motor characteristic	Par. 1-01 = [0] U/f Par. 1-04 Over load = [0] High
	[6] High variable torque with low starting torque	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 45% Par. 1-04 Over load = [0] High

Table 5.20 Conversion of Parameter 101

**Parameter Mapping Lists**
**Operating Instructions**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	101 Torque characteristic	1-03 Torque Characteristics 1-04 Overload Mode 14-40 VT Level
Options	[7] High variable torque with medium starting torque	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 66% Par. 1-04 Over load = [0] High
	[8] High variable torque with high starting torque	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 85% Par. 1-04 Over load = [0] High
	[11] Normal constant torque	Par. 1-03 = [0] Constant torque Par. 1-04 Over load = [1] Normal
	[12] Normal variable torque low	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 45% Par. 1-04 Over load = [1] Normal
	[13] Normal variable torque medium	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 66% Par. 1-04 Over load = [1] Normal
	[14] Normal variable torque high	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 85% Par. 1-04 Over load = [1] Normal
	[15] Normal special motor characteristic	Par. 1-01 = [0] U/f Par. 1-04 Over load = [1] Normal
	[16] Normal variable torque with low constant starting torque	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 45% Par. 1-04 Over load = [1] Normal
	[17] Normal variable torque with medium constant starting torque	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 66% Par. 1-04 Over load = [1] Normal
	[18] Normal variable torque with high constant starting torque	Par. 1-03 = [1] Variable torque Par. 14-40 VT level = 85% Par. 1-04 Over load = [1] Normal

**Table 5.21 Conversion of Parameter 101**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	102 Motor Power	1-20 Motor Power [kW]
Range	0.18 – 600 kW	0.09 – 3000 kW

**Table 5.22 Conversion of Parameter 102**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	103 Motor Voltage	1-22 Motor Voltage
Range	200 – 600 Volt	50 – 1000 V

**Table 5.23 Conversion of Parameter 103**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	104 Motor frequency	1-23 Motor Frequency
Range	20 -1000 Hz	20-1000 Hz

**Table 5.24 Conversion of Parameter 104**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	105 Motor Current	1-24 Motor Current
Range	Power Unit dependable	Power Unit dependable

**Table 5.25 Conversion of Parameter 105**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	106 Rated motor speed	1-25 Motor Nominal Speed
Range	100 – 60000	10 – 60000

**Table 5.26 Conversion of Parameter 106**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	107 Automatic motor adaptation	1-29 Automatic Motor Adaptation (AMA)
Options	[0] Adaptation off	[0] Off
	[1] Adaptation on, Rs and Xs	[1] Enable complete AMA
	[2] Adaptation on, RS	[2] Enable reduce AMA

**Table 5.27 Conversion of Parameter 107**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	108 Stator resistor	1-30 Stator Resistance (Rs)
Range	Power Unit dependable	0.0140 – 140.0000

**Table 5.28 Conversion of Parameter 108**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	109 Stator reactance	1-35 Main Reactance (Xh)
Range	Power Unit dependable	1.0000 – 10000.0000

**Table 5.29 Conversion of Parameter 109**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	110 Motor magnetizing at 0 RPM	1-50 Motor Magnetisation at Zero Speed
Range	0 – 300%	0 – 300%

**Table 5.30 Conversion of Parameter 110**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	111 Min. frequency normal magnetizing	1-52 Min Speed Normal Magnetising [Hz]
Range	0.1 – 10.0 Hz	0.3 – 10.0 Hz

**Table 5.31 Conversion of Parameter 111**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	113 Load compensation at low speed	1-60 Low Speed Load Compensation
Range	0 – 300%	0 – 300%

**Table 5.32 Conversion of Parameter 113**

**Parameter Mapping Lists**
**Operating Instructions**

	VLT 5000 series	FC 302 series
Parameter	114 Load compensation at high speed	1-61 High Speed Load Compensation
Range	0 – 300%	0 – 300%

**Table 5.33 Conversion of Parameter 114**

	VLT 5000 series	FC 302 series
Parameter	115 Slip Compensation	1-62 Slip Compensation
Range	-500 - 500%	-500 - 500%

**Table 5.34 Conversion of Parameter 115**

	VLT 5000 series	FC 302 series
Parameter	116 Slip Compensation Time constant	1-63 Slip Compensation Time Constant
Range	0.05 – 1.00 s	0.05 – 5.00 s

**Table 5.35 Conversion of Parameter 116**

	VLT 5000 series	FC 302 series
Parameter	117 Resonance dampening	1-64 Resonance Dampening
Range	0 - 500%	0 - 500%

**Table 5.36 Conversion of Parameter 117**

	VLT 5000 series	FC 302 series
Parameter	118 Resonance dampening time constant	1-65 Resonance Dampening Time Constant
Range	5 – 50 ms	5 – 50 ms

**Table 5.37 Conversion of Parameter 118**

	VLT 5000 series	FC 302 series
Parameter	119 High starting torque	Not converted

**Table 5.38 Conversion of Parameters 119**

	VLT 5000 series	FC 302 series
Parameter	120 Start delay	1-71 Start Delay
Option	0.0 – 10.0 s	0.0 – 10.0 s

**Table 5.39 Conversion of Parameter 120**

	VLT 5000 series	FC 302 series
Parameter	121 Start function	1-72 Start Function
Options	[0] DC hold in start delay time	[0] DC hold/delay time
	[1] DC brake in start delay time	[1] DC Brake/delay time
	[2] Coasting in start delay time	[2] Coast/delay time
	[3] Start frequency/voltage clockwise	[3] Start speed cw
	[4] Start frequency/voltage in reference direction	[4] Horizontal operation
	[5] VVC <sup>+</sup> clockwise	[5] VVC <sup>+</sup> /Flux clockwise

**Table 5.40 Conversion of Parameter 121**

	VLT 5000 series	FC 302 series
Parameter	122 Function at stop	1-80 Function at Stop
Options	[0] Coasting	[0] Coast
	[1] DC hold	[1] DC hold
	[2] Motor check	[2] Motor check
	[3] Pre-magnetizing	[3] Pre-magnetizing

**Table 5.41 Conversion of Parameter 122**

	VLT 5000 series	FC 302 series
Parameter	123 Min frequency for function at stop	1-82 Min Speed for Function at Stop [Hz]
Range	0.0 – 10.0 Hz	0.0 – 20.0 Hz

**Table 5.42 Conversion of Parameter 123**

	VLT 5000 series	FC 302 series
Parameter	124 DC holding current	2-00 DC Hold/Preheat Current
Range	0 - 100%	0 - 160% (motor depending)

**Table 5.43 Conversion of Parameter 124**

	VLT 5000 series	FC 302 series
Parameter	125 DC braking current	2-01 DC Brake Current
Range	0 - 100%	0 – 160% P.U depending

**Table 5.44 Conversion of Parameter 125**

	VLT 5000 series	FC 302 series
Parameter	126 DC braking time	2-02 DC Braking Time
Range	0.0 – 60.0 s	0.0 – 60.0 s

**Table 5.45 Conversion of Parameter 126**

	VLT 5000 series	FC 302 series
Parameter	127 DC brake cut-in frequency	2-04 DC Brake Cut In Speed [Hz]
Range	0.0 (Off) – $f_{max}$ (par. 202)	0.0 (Off) – $f_{max}$ (par. 414)

Table 5.46 Conversion of Parameter 127

	VLT 5000 series	FC 302 series
Parameter	128 Motor thermal protection	1-90 Motor Thermal Protection
Options	[0] No protection	[0] No protection
[1] Thermistor warning	[1] Thermistor warning	
[2] Thermistor trip	[2] Thermistor trip	
[3] ETR warning 1	[3] ETR warning 1	
[4] ETR trip 1	[4] ETR trip 1	
[5] ETR warning 2	[5] ETR warning 2	
[6] ETR trip 2	[6] ETR trip 2	
[7] ETR warning 3	[7] ETR warning 3	
[8] ETR trip 3	[8] ETR trip 3	
[9] ETR warning 4	[9] ETR warning 4	
[10] ETR trip 4	[10] ETR trip 4	

Table 5.47 Conversion of Parameter 128

	VLT 5000 series	FC 302 series
Parameter	129 External motor fan	1-91 Motor External Fan
Options	[0] No	[0] No
[1] Yes	[1] Yes	

Table 5.48 Conversion of Parameter 129

	VLT 5000 series	FC 302 series
Parameter	130 Start frequency	1-75 Start Speed [Hz]
Range	0.0 – 10.0 Hz	0.0 – 500 Hz P.U depending

Table 5.49 Conversion of Parameter 130

	VLT 5000 series	FC 302 series
Parameter	131 Initial voltage	Not converted

Table 5.50 Conversion of Parameter 131

	VLT 5000 series	FC 302 series
Parameter	145 Minimum DC brake time	Not converted

Table 5.51 Conversion of Parameter 132

### 5.3 VLT® 5000 Parameter Group 2

	VLT 5000 series	FC 302 series
Parameter	200 Output Frequency Range/Direction	4-10 Motor Speed Direction
Options	[0] Only clockwise, 0 – 132 Hz	[0] Clockwise
[1] Both directions, 0 – 132 Hz	[2] Both directions	
[2] Only clockwise, 0 – 1000 Hz	[0] Clockwise	
[3] Both directions, 0 – 1000 Hz	[2] Both directions	
[4] Only counter clockwise, 0 – 132 Hz	[1] Counter clockwise	
[5] Only counter clockwise, 0 – 1000 Hz	[1] Counter clockwise	

Table 5.52 Conversion of Parameter 200

	VLT 5000 series	FC 302 series
Parameter	201 Output frequency low limit	4-12 Motor Speed Low Limit [Hz]
Range	0.0 – par. 202 $F_{max}$	0 – par. 414 $F_{max}$ [Hz]

Table 5.53 Conversion of Parameter 201

	VLT 5000 series	FC 302 series
Parameter	202 Output frequency high limit	4-14 Motor Speed High Limit [Hz] 4-19 Max Output Frequency
Range	0.0 – 132/1000 Hz	0 – 1000 Hz

Table 5.54 Conversion of Parameter 202

	VLT 5000 series	FC 302 series
Parameter	203 Reference/feedback area	3-00 Reference Range
Options	[0] Min – Max	[0] Min – Max
[1] - Max - +Max	[1] - Max - +Max	

Table 5.55 Conversion of Parameter 203

	VLT 5000 series	FC 302 series
Parameter	204 Minimum reference	3-02 Minimum Reference
Range	-100,000.000 – par. 205 $Ref_{max}$	-100,000.000 – par. 3-03 $Ref_{max}$

Table 5.56 Conversion of Parameter 204

	VLT 5000 series	FC 302 series
Parameter	205 Maximum reference Value 6-15 Terminal 53 High Ref./Feedb. Value 5-53 Term. 29 High Ref./Feedb. Value 5-58 Term. 33 High Ref./Feedb. Value	3-03 Maximum Reference 6-15 Terminal 53 High Ref./Feedb. Value 3-02 Ref <sub>min</sub> – 100,000.000
Range	Par. 204 Ref <sub>min</sub> – 100,000.000	Par. 3-02 Ref <sub>min</sub> – 100,000.000

5

Table 5.57 Conversion of Parameter 205

	VLT 5000 series	FC 302 series
Parameter	206 Ramp Type 3-40 Ramp 1 Type 3-50 Ramp 2 Type 3-82 Quick Stop Ramp Type	3-40 Ramp 1 Type 3-50 Ramp 2 Type 3-82 Quick Stop Ramp Type
Options	[0] Linear  [1] Sine shape (S1)  [2] Sin2 Shape (S2)	Par. 3-40 = [0] Linear Par. 3-50 = [0] Linear Par. 3-82 = [0] Linear  Par. 3-40 = [2] S-ramp Const Time Par. 3-45 = 1% Par. 3-46 = 25% Par. 3-47 = 1% Par. 3-48 = 25% Par. 3-50 = [2] S-ramp Const Time Par. 3-55 = 1% Par. 3-56 = 25% Par. 3-57 = 1% Par. 3-58 = 25% Par. 3-82 = [2] S-ramp Const Time Par. 3-83 = 1% Par. 3-84 = 25%  Par. 3-40 = [2] S-ramp Const Time Par. 3-45 = 25% Par. 3-46 = 25% Par. 3-47 = 25% Par. 3-48 = 25% Par. 3-50 = [2] S-ramp Const Time Par. 3-55 = 25% Par. 3-56 = 25% Par. 3-57 = 25% Par. 3-48 = 25% Par. 3-82 = [2] S-ramp Const Time Par. 3-83 = 25% Par. 3-84 = 25%

Table 5.58 Conversion of Parameter 206

	VLT 5000 series	FC 302 series
Parameter	206 Ramp Type 3-40 Ramp 1 Type 3-50 Ramp 2 Type 3-82 Quick Stop Ramp Type	3-40 Ramp 1 Type 3-50 Ramp 2 Type 3-82 Quick Stop Ramp Type
Options	[0] Linear  [1] Sine shape (S1)  [2] Sin2 Shape (S2)	Par. 3-40 = [0] Linear Par. 3-50 = [0] Linear Par. 3-82 = [0] Linear  Par. 3-40 = [2] S-ramp Const Time Par. 3-45 = 1% Par. 3-46 = 25% Par. 3-47 = 1% Par. 3-48 = 25% Par. 3-50 = [2] S-ramp Const Time Par. 3-55 = 1% Par. 3-56 = 25% Par. 3-57 = 1% Par. 3-58 = 25% Par. 3-82 = [2] S-ramp Const Time Par. 3-83 = 1% Par. 3-84 = 25%  Par. 3-40 = [2] S-ramp Const Time Par. 3-45 = 25% Par. 3-46 = 25% Par. 3-47 = 25% Par. 3-48 = 25% Par. 3-50 = [2] S-ramp Const Time Par. 3-55 = 25% Par. 3-56 = 25% Par. 3-57 = 25% Par. 3-48 = 25% Par. 3-82 = [2] S-ramp Const Time Par. 3-83 = 25% Par. 3-84 = 25%

Table 5.59 Conversion of Parameter 206

	VLT 5000 series	FC 302 series
Parameter	207 Ramp up Time 1	3-41 Ramp 1 Ramp Up Time
Range	0.05 – 3600.00 s	0.01 – 3600.00 s

Table 5.60 Conversion of Parameter 207

	VLT 5000 series	FC 302 series
Parameter	208 Ramp down Time 1	3-42 Ramp 1 Ramp Down Time
Range	0.05 – 3600.00 s	0.01 – 3600.00 s

Table 5.61 Conversion of Parameter 208

	VLT 5000 series	FC 302 series
Parameter	209 Ramp up Time 2	3-51 Ramp 2 Ramp Up Time
Range	0.05 – 3600.00 s	0.01 – 3600.00 s

Table 5.62 Conversion of Parameter 209

	VLT 5000 series	FC 302 series
Parameter	210 Ramp down Time 2	3-52 Ramp 2 Ramp Down Time
Range	0.05 – 3600.00 s	0.01 – 3600.00 s

Table 5.63 Conversion of Parameter 210

**Parameter Mapping Lists**
**Operating Instructions**

	VLT 5000 series	FC 302 series
Parameter	211 Jog ramp time	3-80 Jog Ramp Time
Range	0.05 – 3600.00 s	0.01 – 3600.00 s

**Table 5.64 Conversion of Parameter 211**

	VLT 5000 series	FC 302 series
Parameter	212 Quick stop ramp time	3-81 Quick Stop Ramp Time
Range	0.05 – 3600.00 s	0.01 – 3600.00 s

**Table 5.65 Conversion of Parameter 212**

	VLT 5000 series	FC 302 series
Parameter	213 Jog Frequency	3-11 Jog Speed [Hz]
Range	0.0 – par. 202	0.0 – par. 4-14

**Table 5.66 Conversion of Parameter 213**

	VLT 5000 series	FC 302 series
Parameter	214 Reference function	3-04 Reference Function
Options	[0] Sum	[0] Sum
	[1] Relative	See comment below*
	[2] External/Preset	[2] External/Preset

**Table 5.67 Conversion of Parameter 214**

\*= Relative reference is added to the MRV from PROFIBUS.

	VLT 5000 series	FC 302 series
Parameter	215 Preset Reference 1	3-10 Preset Reference
Range	-100.00 – 100.00%	-100.00 – 100.00%

**Table 5.68 Conversion of Parameter 215**

	VLT 5000 series	FC 302 series
Parameter	216 Preset Reference 2	3-10 Preset Reference
Range	-100.00 – 100.00%	-100.00 – 100.00%

**Table 5.69 Conversion of Parameter 216**

	VLT 5000 series	FC 302 series
Parameter	217 Preset Reference 3	3-10 Preset Reference
Range	-100.00 – 100.00%	-100.00 – 100.00%

**Table 5.70 Conversion of Parameter 217**

	VLT 5000 series	FC 302 series
Parameter	218 Preset Reference 4	3-10 Preset Reference
Range	-100,00 - 100,00%	-100,00 - 100,00%

**Table 5.71 Conversion of Parameter 218**

	VLT 5000 series	FC 302 series
Parameter	219 Catch up/slow down value	3-12 Catch up/slow Down Value
Range	0.00 – 100%	0.00 – 100%

**Table 5.72 Conversion of Parameter 219**

	VLT 5000 series	FC 302 series
Parameter	221 Torque limit for motor mode	4-16 Torque Limit Motor Mode
Range	0.0 – Max. torque %	0.0 – Max. torque %

**Table 5.73 Conversion of Parameter 221**

	VLT 5000 series	FC 302 series
Parameter	222 Torque limit for generating mode	4-17 Torque Limit Generator Mode
Range	0.0 – Max. torque %	0.0 – Max. torque %

**Table 5.74 Conversion of Parameter 222**

	VLT 5000 series	FC 302 series
Parameter	223 Warning: Current Low	4-50 Warning Current Low
Range	0.0 – par. 2-24 Current High	2-20 Release Brake Current

**Table 5.75 Conversion of Parameter 223**

	VLT 5000 series	FC 302 series
Parameter	224 Warning: Current High	4-51 Warning Current High
Range	Power Unit dependable	Power Unit dependable

**Table 5.76 Conversion of Parameter 224**

	VLT 5000 series	FC 302 series
Parameter	225 Warning Low Frequency	4-52 Warning Speed Low
Range	0,0 – par. 226	2-22 Activate Brake Speed [Hz]

**Table 5.77 Conversion of Parameter 225**

	VLT 5000 series	FC 302 series
Parameter	226 Warning High Frequency	4-53 Warning Speed High
Range	par. 2-25 – par. 202	Par. 4-52 – par. 4-13

**Table 5.78 Conversion of Parameter 226**

	VLT 5000 series	FC 302 series
Parameter	227 Warning Low Feedback	4-56 Warning Feedback Low
Range	-100,000,000 – par. 228	-999,999,999 – par. 4-57

**Table 5.79 Conversion of Parameter 227**

	VLT 5000 series	FC 302 series
Parameter	228 Warning High Feedback	4-57 Warning Feedback High
Range	par. 227 – 100,000,000	Par. 4-56 – 999,999,999

**Table 5.80 Conversion of Parameter 228**

	VLT 5000 series	FC 302 series
Parameter	229 Frequency bypass, bandwidth	Stored in EEPROM only
Range	0 - 100%	

Table 5.81 Conversion of Parameter 229

	VLT 5000 series	FC 302 series
Parameter	230 Frequency Bypass 1	4-61 Bypass Speed From [Hz] 4-63 Bypass Speed To [Hz]
Range	0 - par. 200	0 - par. 4-14

Table 5.82 Conversion of Parameter 230

	VLT 5000 series	FC 302 series
Parameter	2-31 Frequency Bypass 2	4-61 Bypass Speed From [Hz] 4-63 Bypass Speed To [Hz]
Range	0 - par. 200	0 - par. 4-14

Table 5.83 Conversion of Parameter 231

	VLT 5000 series	FC 302 series
Parameter	232 Frequency Bypass 3	4-61 Bypass Speed From [Hz] 4-63 Bypass Speed To [Hz]
Range	0 - par. 200	0 - par. 4-14

Table 5.84 Conversion of Parameter 232

	VLT 5000 series	FC 302 series
Parameter	233 Frequency Bypass 4	4-61 Bypass Speed From [Hz] 4-63 Bypass Speed To [Hz]
Range	0 - par. 200	0 - par. 4-14

Table 5.85 Conversion of Parameter 233

	VLT 5000 series	FC 302 series
Parameter	234 Motor phase monitor	4-58 Missing Motor Phase Function
Range	[0] Enable	[2] Trip 1000 ms

Table 5.86 Conversion of Parameter 234

## 5.4 VLT® 5000 Parameter Group 3

	VLT 5000 series	FC 302 series
Parameter	300 Terminal 16, input	5-16 Terminal X30/2 Digital Input
Options	[0] No function [1] Reset [2] Stop inverse [3] Only start clockwise, on [4] Jog [5] Preset reference, on [6] Preset reference, lsb [7] Freeze reference [8] Freeze output [9] Speed up [10] Choice of setup, lsb [11] Catch-up [12] Ramp 2 [13] Mains failure inverted [29] Data change lock	[0] No function [1] Reset [6] Stop inverse [12] Enable start forward [14] Jog [15] Preset reference, on [16] Preset reference bit 0 [17] Freeze reference [20] Freeze output [21] Speed up [23] Setup select bit 0 [28] Catch-up [34] Ramp bit 0 Not supported Not supported
Comments	FC 302 does not have a digital input 16, so this is linked to 5-16 Terminal X30/2 Digital Input	

Table 5.87 Conversion of Parameter 300

	VLT 5000 series	FC 302 series
Parameter	301 Terminal 17, input	5-17 Terminal X30/3 Digital Input
Options	[0] No function [1] Reset [2] Stop inverse [3] Only start anticlockwise, on [4] Jog [5] Preset reference, on [6] Preset reference, msb [7] Freeze reference [8] Freeze output [9] Speed down [10] Choice of setup, msb [11] Slow down [12] Ramp 2 [13] Mains failure inverted [23] Pulse reference [24] Safety interlock [29] Data change lock	[0] No operation [1] Reset [6] Stop inverse [13] Enable start reverse [14] Jog [15] Preset reference, on [17] Preset reference bit 1 [19] Freeze reference [20] Freeze output [22] Speed down [24] Setup select bit 1 [29] Slow down [34] Ramp bit 0 Not supported Not supported Not supported
Comments	FC 302 does not have a digital input 17, so this is linked to 5-16 Terminal X30/2 Digital Input	

Table 5.88 Conversion of Parameter 301

	VLT 5000 series	FC 302 series
Parameter	302 Terminal 18, input	5-10 Terminal 18 Digital Input
Options	[0] No function [1] Start [2] Latched start [3] Only start clockwise, on	[0] No operation [8] Start [9] Latched start [12] Enable start forward

Table 5.89 Conversion of Parameter 302

	VLT 5000 series	FC 302 series
Parameter	303 Terminal 19, input	5-11 Terminal 19 Digital Input
Options	[0] No function [1] Reversing [2] Start reversing [3] Only start anticlockwise, on	[0] No operation [10] Reversing [11] Start reversing [13] Enable start reverse

Table 5.90 Conversion of Parameter 303

	VLT 5000 series	FC 302 series
Parameter	304 Terminal 27, input	5-12 Terminal 27 Digital Input
Options	[0] Coasting stop, inverse [1] Reset and Coasting stop, inv. [2] Quick-stop, inverse [3] DC-braking, inverse [4] Stop inverse	[2] Coast inverse [3] Coast and reset inv [4] Quick-stop, inverse [5] DC-brake inverse [6] Stop inverse

Table 5.91 Conversion of Parameter 304

	VLT 5000 series	FC 302 series
Parameter	305 Terminal 29, input	5-13 Terminal 29 Digital Input
Options	[0] No function [1] Reset [2] Stop inverse [3] Only start clockwise, on [4] Only start anticlockwise, on [5] Jog [6] Preset reference, on [7] Preset reference, lsb [8] Preset reference, msb [9] Freeze reference [10] Freeze output [11] Speed up [12] Speed down [13] Choice of Setup, lsb [14] Choice of Setup, msb [15] Catch up [16] Slow down [17] Ramp 2 [18] Mains failure inverted [28] Pulse reference [29] Data change lock	[0] No operation [1] Reset [6] Stop inverse [12] Enable start forward [13] Enable start reverse [14] Jog [15] Preset reference, on [16] Preset reference bit 0 [17] Preset reference bit 1 [19] Freeze reference [20] Freeze output [21] Speed up [22] Speed down [23] Setup select bit 0 [24] Setup select bit 1 [28] Catch up [29] Slow down [34] Ramp bit 0 Not supported Not supported [32] Pulse input Not supported

Table 5.92 Conversion of Parameter 305

	VLT 5000 series	FC 302 series
Parameter	306 Terminal 32, input	5-14 Terminal 32 Digital Input
Options	[0] No function [1] Reset [2] Stop inverse [3] Only start clockwise, on [4] Jog [5] Preset reference, on [6] Preset reference, lsb [7] Freeze reference [8] Freeze output [9] Speed up [10] Choice of Setup, lsb [11] Choice of Setup, msb / Speed up [12] Catch up [13] Ramp 2 [14] Mains failure inverted [24] Encoder input 2A [29] Data change lock	[0] No operation [1] Reset [6] Stop inverse [12] Enable start forward [14] Jog [15] Preset reference, on [16] Preset reference bit 0 [19] Freeze reference [20] Freeze output [21] Speed up [23] Setup select bit 0 Not supported [28] Catch up [34] Ramp bit 0 Not supported [0] No operation Not supported

Table 5.93 Conversion of Parameter 306

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	307 Terminal 33, input	5-15 Terminal 33 Digital Input 7-00 Speed PID Feedback Source
Options	[0] No function [1] Reset [2] Stop inverse [3] Only start anticlockwise, on [4] Jog [5] Preset reference, on [6] Preset reference, msb [7] Freeze reference [8] Freeze output [9] Speed down [10] Choice of Setup, msb [11] Choice of Setup, msb / Speed down [12] Slow down [13] Ramp 2 [14] Mains failure inverted [24] Pulse feedback [25] Encoder input 2B [29] Data change lock	[0] No operation [1] Reset [6] Stop inverse [13] Enable start reverse anticlockwise, on [14] Jog [15] Preset reference, on [17] Preset reference bit 1 [19] Freeze reference [20] Freeze output [22] Speed down [24] Setup select bit 1 Not supported [29] Slow down [34] Ramp bit 0 Not supported [32] Pulse input, Parameter 700 = [9] Frequency input 33 [0] No operation Parameter 700 = [1] 24 V encoder Not supported

**Table 5.94 Conversion of Parameter 307**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	308 Terminal 53, Analogue Input Voltage	3-15 Reference 1 Source 7-00 Speed PID Feedback Source 1-93 Thermistor Source 4-20 Torque Limit Factor Source
Options	[0] No Operation [1] Reference [2] Feedback signal [3] Torque limit [4] Thermistor	Par. 3-15 Reference resource 1 set to [0] No function Par. 3-15 Reference resource 1 set to [1] Analog input 53 Par. 3-15 Reference resource 1 set to [1] Analog input 53 Par. 3-15 Reference resource 1 set to [1] Analog input 53 Par. 4-20 Torque Limit Factor Source set to [2] Analog in 53 Par. 3-15 Reference resource 1 set to [0] No function Par. 1-93 Thermistor Ressource set to [1] Analog input 53

**Table 5.95 Conversion of Parameter 308**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	309 Terminal 53, min.	6-10 Terminal 53 Low Voltage
Range	0 – 10.0 Volt	-10.00 – Par. 6-11

**Table 5.96 Conversion of Parameter 309**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	310 Terminal 53, max.	6-11 Terminal 53 High Voltage
Range	0 – 10.0 Volt	Par. 6-10 - 10.00 Volt

**Table 5.97 Conversion of Parameter 310**

	VLT 5000 series	FC 302 series
Parameter	311 Terminal 54, Analogue Input Voltage	3-16 Reference 2 Source 7-00 Speed PID Feedback Source 4-20 Torque Limit Factor Source 1-93 Thermistor Source 4-21 Speed Limit Factor Source
Options	[0] No Operation	Par. 3-16 Reference resource 2 set to [0] No function
	[1] Reference	Par. 3-16 Reference resource 1 set to [2] Analog input 53
	[2] Torque limit	Par. 4-20 Torque Limit Factor Source set to [6] Analog in 54
	[3] Thermistor	Par. 1-93 Thermistor Ressource set to [2] Analog input 54
	[4] Relative reference	Not supported
	[5] Max. torque frequency	Par. 4-21 Speed Limit Factor Source set to [6] Analog in 54

Table 5.98 Conversion of Parameter 311

	VLT 5000 series	FC 302 series
Parameter	312 Terminal 54, min. scaling	6-20 Terminal 54 Low Voltage
Range	0 – 10.0 Volt	-10.00 – Par. 6-21

Table 5.99 Conversion of Parameter 312

	VLT 5000 series	FC 302 series
Parameter	313 Terminal 54, max. scaling	6-21 Terminal 54 High Voltage
Range	0 – 10.0 Volt	Par. 6-20 - 10.00 Volt

Table 5.100 Conversion of Parameter 313

	VLT 5000 series	FC 302 series
Parameter	314 Terminal 60, Analogue Input current	3-17 Reference 3 Source 7-00 Speed PID Feedback Source 1-93 Thermistor Source 4-20 Torque Limit Factor Source
Options	[0] No Operation	Par. 3-17 Reference resource 3 set to [0] No function
	[1] Reference	Par. 3-17 Reference resource 3 set to [2] Analog input 54 Par. 7-00 Speed PID Feedback Source set to [7] Analog input 54
	[2] Feedback signal	Par. 7-00 Speed PID Feedback Source set to [7] Analog input 54
	[3] Torque limit	Par. 3-17 Reference resource 3 set to [2] Analog input 54 Par. 4-20 Torque Limit Factor Source set to [6] Analog in 54
	[4] Relative reference	Not supported
Comments	The HW switch S202 for analogue input 54 must be set to current (ON).	

Table 5.101 Conversion of Parameter 314

	VLT 5000 series	FC 302 series
Parameter	315 Terminal 60, min. scaling	6-22 Terminal 54 Low Current
Range	0.0 – 20.0 mA	0.00 – Par. 6-23

Table 5.102 Conversion of Parameter 315

	VLT 5000 series	FC 302 series
Parameter	316 Terminal 60, max. scaling	6-23 Terminal 54 High Current
Range	0.0 – 20.0 mA	Par. 6-22 - 20.00 mA

Table 5.103 Conversion of Parameter 316

	VLT 5000 series	FC 302 series
Parameter	317 Time Out	6-00 Live Zero Timeout Time
Range	0 – 99 sec	0 – 99 sec

Table 5.104 Conversion of Parameter 317

	VLT 5000 series	FC 302 series
Parameter	318 Function after time out	6-01 Live Zero Timeout Function
Options	[0] Off	[0] Off
	[1] Freeze output frequency	[1] Freeze output frequency
	[2] Stop	[2] Stop
	[3] Jogging	[3] Jog
	[4] Max Speed, p202	[4] Max Speed
	[5] Stop and trip	[5] Stop and trip

5

Table 5.105 Conversion of Parameter 318

	VLT 5000 series	FC 302 series
Parameter	319 Terminal 42, Output	Digital = Par. 5-32 DO X30/7 (MCB 101) Analogue values = Par. 6-50 AO 42 Pulse = Par. 5-66 DO X30/6
Parameter	321 Terminal 45, Output	Digital = Par. 5-33 DO X30/7 (MCB 101) Analogue values= Par. 6-60 AO X30/8 Pulse = Par. 5-66 DO X30/6
Options	[0] No function	Par. 5-32 = [0] No operation
	[1] Control Ready	Par. 5-32 = [1] Control Ready
	[2] Ready signal	Par. 5-32 = [2] Drive ready
	[3] Ready - Remote Control	Par. 5-32 = [3] Drive rdy/rem ctrl
	[4] Enabled, no warning	Par. 5-32 = [4] Enable / no warning
	[5] Running	Par. 5-32 = [5] VLT® running
	[6] Running, no Warning	Par. 5-32 = [6] Running /no warning
	[7] Running within range, no Warning	Par. 5-32 = [7] Run in range/no warning
	[8] Run at reference, no Warning	Par. 5-32 = [8] Run on ref/no warning
	[9] Alarm	Par. 5-32 = [9] Alarm
	[10] Alarm or Warning	Par. 5-32 = [10] Alarm or Warning
	[11] Torque limit	Par. 5-32 = [11] At torque limit
	[12] Out of current range	Par. 5-32 = [12] Out of current range
	[13] Above I low	Par. 5-32 = [13] Below current, low <sup>1)</sup>
	[14] Under I high	Par. 5-32 = [14] Above current, high <sup>1)</sup>

Table 5.106 Conversion of Parameters 319 to 321

	VLT 5000 series	FC 302 series
Parameter	319 Terminal 42, Output	Digital = Par. 5-32 DO X30/7 (MCB 101) Analogue values= Par. 6-50 AO 42 Pulse = Par. 5-66 DO X30/6
Parameter	321 Terminal 45, Output	Digital = Par. 5-33 DO X30/7 (MCB 101) Analogue values= Par. 6-60 AO X30/8 Pulse = Par. 5-66 DO X30/6
Options	[15] Out of frequency range	Par. 5-32 = [15] Out of speed range
	[16] Over f low	Par. 5-32 = [16] Below speed low <sup>1)</sup>
	[17] Under f high	Par. 5-32 = [17] Above speed high <sup>1)</sup>
	[18] Out of feedback range	Par. 5-32 = [18] Out of feedb. Range
	[19] Over feedback low	Par. 5-32 = [19] Below feedback low <sup>1)</sup>
	[20] Under feedback high	Par. 5-32 = [20] Above feedback high <sup>1)</sup>
	[21] Thermal warning	Par. 5-32 = [21] Thermal warning
	[22] Ready, no thermal warning	Par. 5-32 = [12] Ready,no thermal W
	[23] Ready - remote control - no thermal warning	Par. 5-32 = [23] Remote, ready, no TW
	[24] Ready – mains voltage within range	Par. 5-32 = [24] Ready, Voltage OK
	[25] Reversing	Par. 5-32 = [25] Reverse
	[26] Bus OK	Par. 5-32 = [26] Bus OK
	[27] Torque limit and stop	Par. 5-32 = [27] Torque limit & stop

Table 5.107 Conversion of Parameters 319 to 321

	VLT 5000 series	FC 302 series
Parameter	319 Terminal 42, Output	Digital = Par. 5-32 DO X30/7 (MCB 101) Analogue values= Par. 6-50 AO 42 Pulse = Par. 5-66 DO X30/6
Parameter	321 Terminal 45, Output	Digital = Par. 5-33 DO X30/7 (MCB 101) Analogue values= Par. 6-60 AO X30/8 Pulse = Par. 5-66 DO X30/6
Options	[28] Brake, no brake warning	Par. 5-32 = [28] Brake, no brake warning
	[29] Brake ready, no fault	Par. 5-32 = [29] Brake ready, no fault
	[30] Brake fault	Par. 5-32 = [30] Brake fault (IGBT)
	[31] Relay 123	Par. 5-32 = [31] Relay 123
	[32] Mechanical brake control	Par. 5-32 = [32] Mech brake ctrl
	[34] Extended mechanical brake control	Par. 5-32 = [32] Mech brake ctrl
	[35] Safety Interlock	Not supported
	[36] 0 – 100 Hz ⇒ 0 – 20 mA	Not supported
	[37] 0 – 100 Hz ⇒ 4 – 20 mA	Not supported
	[38] 0 – 100 Hz ⇒ 0 – 32000 p	Not supported
	[39] 0 – f max ⇒ 0 – 20 mA	Par. 6-50 = [109] Max Out freq. 0 – 20 mA
	[40] 0 – f max ⇒ 4 – 20 mA	Par. 6-50 = [130] Max Out freq. 4 – 20 mA
	[41] 0 – f max ⇒ 0 – 32000 p	Par. 5-66 = [109] Max Out freq. 0 – 32000p Par. 568 = 32000
	[42] Ref min – Ref max ⇒ 0 – 20 mA	Par. 6-50 = [101] Reference 0 -20 mA

Table 5.108 Conversion of Parameters 319 to 321

	VLT 5000 series	FC 302 series
Parameter	319 Terminal 42, Output	Digital = Par. 5-32 DO X30/7 (MCB 101) Analogue values= Par. 6-50 AO 42 Pulse = Par. 5-66 DO X30/6
Parameter	321 Terminal 45, Output	Digital = Par. 5-33 DO X30/7 (MCB 101) Analogue values= Par. 6-60 AO X30/8 Pulse = Par. 5-66 DO X30/6
Options	[43] Ref min – Ref max ⇒ 4 – 20 mA	Par. 6-50 = [131] Reference 4 -20 mA
	[44] Ref min – Ref max ⇒ 0 – 32000 p	Par. 5-66 = [101] Reference 0 – 32000p Par. 5-68 = 32000
	[45] FB min – FB max ⇒ 0 – 20 mA	Par. 6-50 = [102] Feedback 0 -20 mA
	[46] FB min – FB max ⇒ 4 – 20 mA	Par. 6-50 = [132] Feedback 4 -20 mA
	[47] FB min – FB max ⇒ 0 – 32000 p	Par. 5-66 = [102] Feedback 0 – 32000p Par. 5-68 = 32000
	[48] 0 – I max ⇒ 0 – 20 mA	Par. 6-50 = [103] Motor current 0 -20 mA
	[49] 0 – I max ⇒ 4 – 20 mA	Par. 6-50 = [133] Motor current 4 -20 mA
	[50] 0 – I max ⇒ 0 – 32000 p	Par. 5-66 = [103] Motor current 0 - 32000p Par. 5-68 = 32000
	[51] 0 – T lim ⇒ 0 – 20 mA	Par. 6-50 = [104] Torque related to limit 0 - 20 mA
	[52] 0 – T lim ⇒ 4 – 20 mA	Par. 6-50 = [134] Torque related to limit 4 - 20 mA
	[53] 0 – T lim ⇒ 0 – 32000 p	Par. 5-66 = [104] Torque related to limit 0 – 32000p Par. 5-68 = 32000
	[54] 0 – T nom ⇒ 0 – 20 mA	Par. 6-50 = [105] Torque related to norm 0 - 20 mA
	[55] 0 – T nom ⇒ 4 – 20 mA	Par. 6-50 = [135] Torque related to norm 4 - 20 mA
	[56] 0 – T nom ⇒ 0 – 32000 p	Par. 5-66 = [105] Torque related to norm 0 – 32000p Par. 5-68 = 32000
	[57] 0 – P nom ⇒ 0 – 20 mA	Par. 6-50 = [106] Power related to norm 0 - 20 mA
	[58] 0 – P nom ⇒ 4 – 20 mA	Par. 6-50 = [136] Power related to norm 4 - 20 mA
	[59] 0 – P nom ⇒ 0 – 32000 p	Par. 5-66 = [106] Power related to norm 0 – 32000p Par. 5-68 = 32000

Table 5.109 Conversion of Parameters 319 to 321

	VLT 5000 series	FC 302 series
Parameter	319 Terminal 42, Output	Digital = Par. 5-32 DO X30/7 (MCB 101) Analogue values= Par. 6-50 AO 42 Pulse = Par. 5-66 DO X30/6
Parameter	321 Terminal 45, Output	Digital = Par. 5-33 DO X30/7 (MCB 101) Analogue values= Par. 6-60 AO X30/8 Pulse = Par. 5-66 DO X30/6
Options	[60] 0 – SyncRPM ⇒ 0 – 20 mA  [61] 0 – SyncRPM ⇒ 4 – 20 mA  [62] 0 – SyncRPM ⇒ 0 – 32000 p  [63] RPM at F max ⇒ 0 – 20 mA  [64] RPM at F max ⇒ 4 – 20 mA  [65] RPM at F max ⇒ 0 – 32000 p	Not supported  Not supported  Not supported  Par. 6-50 = [107] Speed related to norm 0 - 20 mA  Par. 6-50 = [137] Speed related to norm 4 - 20 mA  Par. 5-66 = [107] Speed related to norm 0 – 32000p Par. 5-68 = 32000

Table 5.110 Conversion of Parameters 319 to 321

	VLT 5000 series	FC 302 series
Parameter	320 Terminal 42 Output, pulse scaling	5-68 Pulse Output Max Freq #X30/6
Range	1 – 32000 Hz	0 – 32000 Hz

Table 5.111 Conversion of Parameter 320

	VLT 5000 series	FC 302 series
Parameter	322 Terminal 45 Output, pulse scaling	5-68 Pulse Output Max Freq #X30/6
Range	1 – 32000 Hz	0– 32000 Hz

Table 5.112 Conversion of Parameter 322

	VLT 5000 series	FC 302 series
Parameter	323, 326	5-40 Function Relay
Range	01 Relay 04 Relay	Relay 1 Relay 2
	[0] No function	Par. 5-40 = [0] No operation
	[1] Control Ready	Par. 5-40 = [1] Control Ready
	[2] Ready signal	Par. 5-40 = [2] Drive ready
	[3] Ready - Remote Control	Par. 5-40 = [3] Drive rdy/rem ctrl
	[4] Enabled, no warning	Par. 5-40 = [4] Enable / no warning
	[5] Running	Par. 5-40 = [5] VLT running
	[6] Running, no Warning	Par. 5-40 = [6] Running / no warning
	[7] Running within range, no warning	Par. 5-40 = [7] Run in range/no warn
	[8] Run at reference, no Warning	Par. 5-40 = [8] Run on ref/no warn
	[9] Alarm	Par. 5-40 = [9] Alarm
	[10] Alarm or Warning	Par. 5-40 = [10] Alarm or Warning
	[11] Torque limit	Par. 5-40 = [11] At torque limit
	[12] Out of current range	Par. 5-40 = [12] Out of current range
	[13] Above I low	Par. 5-40 = [13] Below current, low <sup>1)</sup>
	[14] Under I high	Par. 5-40 = [14] Above current, high <sup>1)</sup>
	[15] Out of frequency range	Par. 5-40 = [15] Out of speed range
	[16] Over f low	Par. 5-40 = [16] Below speed low <sup>1)</sup>
	[17] Under f high	Par. 5-40 = [17] Above speed high <sup>1)</sup>
	[18] Out of feedback range	Par. 5-40 = [18] Out of feedb. Range
	[19] Over feedback low	Par. 5-40 = [16] Below feedback low <sup>1)</sup>
	[20] Under feedback high	Par. 5-40 = [17] Above feedback high <sup>1)</sup>
	[21] Thermal warning	Par. 5-40 = [21] Thermal warning

Table 5.113 Conversion of Parameters 323 to 326

**Parameter Mapping Lists**
**Operating Instructions**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	323, 326	5-40 Function Relay
Range	[22] Ready, no thermal warning [23] Ready - remote control - no thermal warning [24] Ready – mains voltage within range [25] Reversing [26] Bus OK [27] Torque limit and stop [28] Brake, no brake warning [29] Brake ready, no fault [30] Brake fault [31] Relay 123 [32] Mechanical brake control [33] Control word bit 11/12 [34] Extended mechanical brake control [35] Safety Interlock	Par. 5-40 = [22] Ready,no thermal W Par. 5-40 = [23] Remote, ready, no TW Par. 5-40 = [24] Ready, Voltage OK Par. 5-40 = [25] Reverse Par. 5-40 = [26] Bus OK Par. 5-40 = [27] Torque limit & stop Par. 5-40 = [28] Brake, no brake warning Par. 5-40 = [29] Brake ready, no fault Par. 5-40 = [30] Brake fault (IGBT) Par. 5-40 = [31] Relay 123 Par. 5-40.0 = [32] Mech brake ctrl Par. 1-72 = [5] VVC+/Flux Par. 5-40 = [36] Control word bit 11 Par. 5-40.1 = [37] Control word bit 12 Par. 5-40 = [32] Mech brake ctrl Par. 1-72 = [5] VVC+/Flux Not supported

**Table 5.114 Conversion of Parameters 323 to 326**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	324 Relay 01, ON delay	5-41 On Delay, Relay
Range	0.00 – 600.00 sec	0.01 – 600.00 sec

**Table 5.115 Conversion of Parameter 324**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	325 Relay 01, OFF delay	5-42 Off Delay, Relay
Range	0.00 – 600.00 s	0.01 – 600.00 s

**Table 5.116 Conversion of Parameter 325**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	327 Pulse reference, max. freq	5-51 Term. 29 High Frequency
Range	100 – 65000 Hz	0 – 110000 Hz

**Table 5.117 Conversion of Parameter 327**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	328 Pulse feedback, max. freq	5-56, 5-50, 5-55
Range	100 – 65000 Hz	0 – 110000 Hz

**Table 5.118 Conversion of Parameter 328**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	329 Encoder feedback	5-70 Term 32/33 Pulses Per Revolution
Range	1 – 4096 pulses	1 – 4096 pulses

**Table 5.119 Conversion of Parameter 329**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	330 Freeze ref. /output function	Not converted

**Table 5.120 Conversion of Parameter 330**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	345 Encoder loss timeout	4-32 Motor Feedback Loss Timeout
Range	0.0 – 60.0 s	0.00 – 60.00 s

**Table 5.121 Conversion of Parameter 345**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	346 Encoder loss function	4-30 Motor Feedback Loss Function
Range	[0] Off [1] Freeze output frequency [3] Jog [4] Max speed [5] Stop and trip [7] Select setup 4	[0] Disable [4] Freeze output frequency [3] Jog [5] Max speed [11] Stop and trip [10] Select setup 4

**Table 5.122 Conversion of Parameter 346**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	357 Term. 42, Output min. scale	6-51 Terminal 42 Output Min Scale
Range	0 – 100%	0 – 200%

**Table 5.123 Conversion of Parameter 357**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	358 Term. 42, Output max. scale	6-52 Terminal 42 Output Max Scale
Range	0 – 500%	0 – 200%

**Table 5.124 Conversion of Parameter 358**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	359 Term. 45, Output min. scale	6-61 Terminal X30/8 Min. Scale
Range	0 – 100%	0 – 200%

**Table 5.125 Conversion of Parameter 359**

	VLT 5000 series	FC 302 series
Parameter	360 Term. 45, Output max. scale	6-62 Terminal X30/8 Max. Scale
Range	0 – 500%	0 – 200%

Table 5.126 Conversion of Parameter 360

	VLT 5000 series	FC 302 series
Parameter	361 Encoder loss threshold	Not converted
Range	0 – 600%	

Table 5.127 Conversion of Parameter 361

5

## 5.5 VLT® 5000 Parameter Group 4

	VLT 5000 series	FC 302 series
Parameter	400 Brake function/ over voltage cont.	2-10 Brake Function 2-17 Over-voltage Control
Options	[0] Off	[0] Off
[1] Resistor brake	Par. 2-10 = *1* Resistor brake Par. 2-17 = [0] Off	
[2] Over voltage control	Par. 2-10 = [0] Off Par. 2-17 = [2] Enabled	
[3] Over voltage control and stop	Par. 2-10 = [0] Off Par. 2-17 = [1] Enabled (not at stop)	

Table 5.128 Conversion of Parameter 400

	VLT 5000 series	FC 302 series
Parameter	401 Brake resistor, [ $\Omega$ ]	30-81 Brake Resistor (ohm)
Options	Power unit dependable	Power unit dependable

Table 5.129 Conversion of Parameter 401

	VLT 5000 series	FC 302 series
Parameter	402 Brake power limit, [kW]	2-12 Brake Power Limit (kW)
Range	Depends on unit	Depends on unit

Table 5.130 Conversion of Parameter 402

	VLT 5000 series	FC 302 series
Parameter	403 Power monitoring	2-13 Brake Power Monitoring
Options	[0] Off	[0] Off
[1] Warning	[1] Warning	
[2] Trip	[2] Trip	

Table 5.131 Conversion of Parameter 403

	VLT 5000 series	FC 302 series
Parameter	404 Brake check	2-15 Brake Check
Options	[0] Off	[0] Off
[1] Warning	[1] Warning	
[2] Trip	[2] Trip	

Table 5.132 Conversion of Parameter 404

	VLT 5000 series	FC 302 series
Parameter	405 Reset	14-20 Reset Mode
Options	[0] Manual reset	[0] Off
	[1] Automatic reset x 1	[1] Automatic reset x 1
	[2] Automatic reset x 2	[2] Automatic reset x 2
	[3] Automatic reset x 3	[3] Automatic reset x 3
	[4] Automatic reset x 4	[4] Automatic reset x 4
	[5] Automatic reset x 5	[5] Automatic reset x 5
	[6] Automatic reset x 6	[6] Automatic reset x 6
	[7] Automatic reset x 7	[7] Automatic reset x 7
	[8] Automatic reset x 8	[8] Automatic reset x 8
	[9] Automatic reset x 9	[9] Automatic reset x 9
	[10] Automatic reset x 10	[10] Automatic reset x 10

Table 5.133 Conversion of Parameter 405

	VLT 5000 series	FC 302 series
Parameter	406 Automatic restart time	14-21 Automatic Restart Time
Range	0 – 10 s	0 – 600 s

Table 5.134 Conversion of Parameter 406

	5000 series	FC 302 series
Parameter	407 Mains failure	14-10 Mains Failure
Data range	[0] No function	[0] No function
	[1] Controlled ramp down	[1] Controlled ramp down
	[2] Controlled ramp down and trip	[2] Controlled ramp down and trip
	[3] Coast	[3] Coast
	[4] Kinetic back-up	[4] Kinetic back-up
	[5] Controlled alarm suppression	[5] Kinetic back-up, trip suppression

Table 5.135 Conversion of Parameter 407

	VLT 5000 series	FC 302 series
Parameter	408 Quick discharge	Not converted

Table 5.136 Conversion of Parameter 408

	VLT 5000 series	FC 302 series
Parameter	409 Trip delay torque	14-25 Trip Delay at Torque Limit
Range	0 – 60 s (60=OFF)	0 – 60 s (60=OFF)

Table 5.137 Conversion of Parameter 409

	VLT 5000 series	FC 302 series
Parameter	410 Trip delay inverter	14-26 Trip Delay at Inverter Fault
Range	0 – 35 s	0 – 35 s

Table 5.138 Conversion of Parameter 410

	VLT 5000 series	FC 302 series
Parameter	411 Switching frequency	14-01 Switching Frequency
Range	Unsigned 16 (6)	Unsigned 8 (5)
	1.5 – 14 kHz	< 2.3 ⇒ 2.0 kHz [2] 2.3 > 2.7 ⇒ 2.5 kHz [3] 2.8 > 3.2 ⇒ 3.0 kHz [4] 3.3 > 3.7 ⇒ 3.5 kHz [5] 3.8 > 4.5 ⇒ 4.0 kHz [6] 4.6 > 5.5 ⇒ 5.0 kHz [7] 5.6 > 6.5 ⇒ 6.0 kHz [8] 6.6 > 7.5 ⇒ 7.0 kHz [9] 7.6 > 9.0 ⇒ 8.0 kHz [10] 9.1 > ⇒ 10.0 kHz [11]

Table 5.139 Conversion of Parameter 411

	VLT 5000 series	FC 302 series
Parameter	412 Output frequency dependent switching frequency	Not converted

Table 5.140 Conversion of Parameter 412

	VLT 5000 series	FC 302 series
Parameter	413 Overmodulation function	14-03 Overmodulation function
Options	[0] Off	[0] Off
	[1] On	[1] On

Table 5.141 Conversion of Parameter 413

	VLT 5000 series	FC 302 series
Parameter	414 Minimum feedback	Not converted

Table 5.142 Conversion of Parameter 414

	VLT 5000 series	FC 302 series
Parameter	415 Maximum feedback	Not converted

Table 5.143 Conversion of Parameter 415

	VLT 5000 series	FC 302 series
Parameter	416 Feedback Unit	3-01 Reference/feedback Unit
Options	[0] None [1] % [2] PPM [3] rpm [4] bar [5] Cycle/min [6] Pulse/s [7] Unit s/s [8] Unit s/min [9] Unit s/h [10] °C [11] Pa [12] l/s [13] m3/s [14] l/min [15] m3/min [16] l/h [17] m3/h [18] kg/s [19] kg/min [20] kg/h [21] t/min [22] t/h [23] m [24] Nm [25] m/s	[0] None [1] % [5] PPM [2] RPM [71] bar Not supported [12] Pulse/s Not supported Not supported Not supported [60] °C [72] Pa [20] l/s [23] m3/s [21] l/min [24] m3/min [22] l/h [25] m3/h [30] kg/s [31] kg/min [32] kg/h [33] t/min [34] t/h [45] m [4] Nm [40] m/s

Table 5.144 Conversion of Parameter 416 Part 1

	VLT 5000 series	FC 302 series
Parameter	416 Feedback Unit	3-01 Reference/feedback Unit
	[26] m/min [27] °F [28] in wg [29] gal/s [30] ft³/s [31] gal/min [32] ft³/min [33] gal/h [34] ft³/h [35] lb/s [36] lb/min [37] lb/h [38] lb ft [39] ft/s [40] ft/min	[41] m/min [160] °F [172] in wg [121] gal/s [125] ft³/s [122] gal/min [126] ft³/min [123] gal/h [127] ft³/h [130] lb/s [131] lb/min [132] lb/h [150] lb ft [140] ft/s [141] ft/min

Table 5.145 Conversion of Parameter 416 Part 2

	VLT 5000 series	FC 302 series
Parameter	417 Speed PID proportional gain	7-02 Speed PID proportional gain
Data range	0.000 – 0.150	0.000 – 1.000

Table 5.146 Conversion of Parameter 417

	VLT 5000 series	FC 302 series
Parameter	418 Speed PID Integral Time	7-03 Speed PID proportional gain
Data range	2.0 – 999.9	2.0 – 20000.0

Table 5.147 Conversion of Parameter 418

	VLT 5000 series	FC 302 series
Parameter	419 Speed PID Differentiation Time	7-04 Speed PID Differentiation Time
Data range	0.0 – 200.0	0.0 – 200.0

Table 5.148 Conversion of Parameter 419

	VLT 5000 series	FC 302 series
Parameter	420 Speed PID D-gain limit	7-05 Speed PID Diff. Gain Limit
Data range	5.0 – 50.0	1.0 – 20.0

Table 5.149 Conversion of Parameter 420

	VLT 5000 series	FC 302 series
Parameter	421 Speed PID low-pass filter	7-06 Speed PID Lowpass Filter Time
Data range	5.0 – 200.0 ms	1.0 – 100.0

Table 5.150 Conversion of Parameter 421

**Parameter Mapping Lists**
**Operating Instructions**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	422 U0 voltage at 0 Hz	1-55 U0 voltage
Data range	0.0 – par. 103	0.0 – 1000.0 V

**Table 5.151 Conversion of Parameter 422**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	423 U1 voltage	1-55 U1 voltage
Data range	0.0 – par. 103	0.0 – 1000.0 V

**Table 5.152 Conversion of Parameter 423**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	424 F1 frequency	1-56 F1 frequency
Data range	0.0 – par. 104	0.0 – 1000.0 Hz

**Table 5.153 Conversion of Parameter 424**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	425 U2 voltage	1-55 U2 voltage
Data range	0.0 – par. 103	0.0 – 1000.0 V

**Table 5.154 Conversion of Parameter 425**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	426 F2 frequency	1-56 F2 frequency
Data range	0.0 – par. 104	0.0 – 1000.0 Hz

**Table 5.155 Conversion of Parameter 426**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	427 U3 voltage	1-55 U3 voltage
Data range	0.0 – par. 103	0.0 – 1000.0 V

**Table 5.156 Conversion of Parameter 427**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	428 F3 frequency	1-56 F3 frequency
Data range	0.0 – par. 104	0.0 – 1000.0 Hz

**Table 5.157 Conversion of Parameter 428**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	429 U4 voltage	1-55 U4 voltage
Data range	0.0 – par. 103	0.0 – 1000.0 V

**Table 5.158 Conversion of Parameter 429**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	430 F4 frequency	1-56 F4 frequency
Data range	0.0 – par. 104	0.0 – 1000.0 Hz

**Table 5.159 Conversion of Parameter 430**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	431 U5 voltage	1-55 U5 voltage
Data range	0.0 – par. 103	0.0 – 1000.0 V

**Table 5.160 Conversion of Parameter 431**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	432 F5 frequency	1-56 F5 frequency
Data range	0.0 – par. 104	0.0 – 1000.0 Hz

**Table 5.161 Conversion of Parameter 432**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	433 Torque control, open loop proportional gain	7-12 Torque PI Integration Time
Data range	0 (Off) – 500%	0 (Off) – 500%

**Table 5.162 Conversion of Parameter 433**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	434 Torque control, open loop integral time	7-13 Torque PI Integration Time
Data range	0.002 – 2.000 sec	0.002 – 2.000 sec

**Table 5.163 Conversion of Parameter 434**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	437 Process PID Normal/Inverse contr	7-30 Process PID Normal/ Inverse Control
Options	[0] Normal	[0] Normal

[1] Inverse	[1] Inverse
-------------	-------------

**Table 5.164 Conversion of Parameter 437**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	438 Process PID Anti windup	7-31 Process PID Anti Windup
Options	[0] Off	[0] Off

[1] On	[1] On
--------	--------

**Table 5.165 Conversion of Parameter 438**

	<b>VLT 5000 series</b>	<b>FC 302 series</b>
Parameter	439 Process PID start frequency	7-32 Process PID Start Speed
Data range	Fmin – fmax	0 – 6000 rpm

**Table 5.166 Conversion of Parameter 439**

**Parameter Mapping Lists**
**Operating Instructions**

	VLT 5000 series	FC 302 series
Parameter	440 Process PID proportional gain	7-33 Process PID proportional gain
Data range	0.00 – 10.00	0.00 – 10.00

**Table 5.167 Conversion of Parameter 440**

	VLT 5000 series	FC 302 series
Parameter	441 Process PID integral time	7-34 Process PID integral time
Data range	0.01 – 9999.99	0.01 – 10000.00

**Table 5.168 Conversion of Parameter 441**

	VLT 5000 series	FC 302 series
Parameter	442 Process PID differentiation time	7-35 Process PID Differentiation Time
Data range	0.00 – 10.00	0.00 – 10.00

**Table 5.169 Conversion of Parameter 442**

	VLT 5000 series	FC 302 series
Parameter	443 Process PID diff. gain limit	7-36 Process PID Diff. Gain Limit
Data range	5.0 – 50.0	0.00 – 10.00

**Table 5.170 Conversion of Parameter 443**

	VLT 5000 series	FC 302 series
Parameter	444 Process PID lowpass filter time	Not supported

**Table 5.171 Conversion of Parameter 444**

	VLT 5000 series	FC 302 series
Parameter	445 Flying start	1-73 Flying Start
Options	[0] Off	[0] Disable
	[1] On	[1] Enable

**Table 5.172 Conversion of Parameter 445**

	VLT 5000 series	FC 302 series
Parameter	446 Switching pattern	14-00 Switching Pattern
Options	[0] 60 AVM	[0] 60 AVM
	[1] SFAVM	[1] SFAVM

**Table 5.173 Conversion of Parameter 446**

	VLT 5000 series	FC 302 series
Parameter	447 Torque compensation	Not supported

**Table 5.174 Conversion of Parameter 447**

	VLT 5000 series	FC 302 series
Parameter	448 Gear ratio	Not supported

**Table 5.175 Conversion of Parameter 448**

	VLT 5000 series	FC 302 series
Parameter	449 Friction loss	Not supported

**Table 5.176 Conversion of Parameter 449**

	VLT 5000 series	FC 302 series
Parameter	450 Mains voltage at mains fault	14-11 Mains Voltage at Mains Fault
Range	180 – 690 V	100 – 800 V

**Table 5.177 Conversion of Parameter 450**

	VLT 5000 series	FC 302 series
Parameter	453 Gear ratio, speed close loop	7-07 Speed PID Feedback Gear Ratio
Range	0.01 – 100.00	0.0001 – 32.0000

**Table 5.178 Conversion of Parameter 453**

	VLT 5000 series	FC 302 series
Parameter	454 Dead time compensation	Not supported

**Table 5.179 Conversion of Parameter 454**

	VLT 5000 series	FC 302 series
Parameter	455 Frequency range monitor	Not supported

**Table 5.180 Conversion of Parameter 455**

	VLT 5000 series	FC 302 series
Parameter	457 Phase loss functions	14-12 Function at Mains Imbalance
Options	[0] Trip	[0] Trip
	[1] Warning	[1] Warning

**Table 5.181 Conversion of Parameter 457**

	VLT 5000 series	FC 302 series
Parameter	483 Dynamic DC link compensation	Not supported

**Table 5.182 Conversion of Parameter 483**

## 5.6 VLT® 5000 Parameter Group 5

	VLT 5000 series	FC 302 series
Parameter	500 Address	8-31 Address
Range	0-126	0-126

Table 5.183 Conversion of Parameter 500

	VLT 5000 series	FC 302 series
Parameter	501 Baud rate	8-32 Baud Rate
Options	[0] 300	Not supported
[1] 600	Not supported	
[2] 1200	Not supported	
[3] 2400	[0] 2400	
[4] 4800	[1] 4800	
[5] 9600	[2] 9600	

Table 5.184 Conversion of Parameter 501

	VLT 5000 series	FC 302 series
Parameter	502 Coasting	8-50 Coasting Select
Parameter	503 Quick - Stop	8-51 Quick Stop Select
Parameter	504 DC brake	8-52 DC Brake Select
Parameter	505 Start	8-53 Start Select
Parameter	506 Reversing	8-54 Reversing Select
Parameter	507 Setup select	8-55 Set-up Select
Parameter	508 Preset reference select	8-56 Preset Reference Select
Parameter type	Unsigned 8 (5)	Unsigned 8 (5)
Options	[0] Digital input	[0] Digital input
[1] Bus	[1] Bus	
[2] Logic AND	[2] Logic AND	
[3] Logic OR	[3] Logic OR	

Table 5.185 Conversion of Parameter 502-508

	VLT 5000 series	FC 302 series
Parameter	509 Bus Jog 1	8-90 Bus Jog 1 Speed
Range	0.0 – par. 202	0.0 – par. 4-13

Table 5.186 Conversion of Parameter 509

	VLT 5000 series	FC 302 series
Parameter	510 Bus Jog 2	8-91 Bus Jog 2 Speed
Range	0.0 – par. 202	0.0 – par. 4-13

Table 5.187 Conversion of Parameter 510

	VLT 5000 series	FC 302 series
Parameter	512 Telegram Profile	8-10 Control Profile
Range	[0] Fieldbus profile	[1] ProfiDrive profile
[1] FC profile	[0] FC profile	

Table 5.188 Conversion of Parameter 512

	VLT 5000 series	FC 302 series
Parameter	513 Bus time interval	Not Converted

Table 5.189 Conversion of Parameter 513

	VLT 5000 series	FC 302 series
Parameter	514 Bus time interval function	Not Converted

Table 5.190 Conversion of Parameter 514

	VLT 5000 series	FC 302 series
Parameter	515 Reference %	16-02 Reference [%]

Table 5.191 Conversion of Parameter 515

	VLT 5000 series	FC 302 series
Parameter	516 Reference Unit	16-01 Reference [Unit]

Table 5.192 Conversion of Parameter 516

	VLT 5000 series	FC 302 series
Parameter	517 Feedback	16-52 Feedback[Unit]

Table 5.193 Conversion of Parameter 517

	VLT 5000 series	FC 302 series
Parameter	518 Frequency	16-13 Frequency

Table 5.194 Conversion of Parameter 518

	VLT 5000 series	FC 302 series
Parameter	519 Frequency x scaling	Not converted

Table 5.195 Conversion of Parameter 519

	VLT 5000 series	FC 302 series
Parameter	520 Current	16-14 Motor current

Table 5.196 Conversion of Parameter 520

	VLT 5000 series	FC 302 series
Parameter	521 Torque	16-22 Torque [%] 16-21 Torque [%] high resolution

Table 5.197 Conversion of Parameter 521

	VLT 5000 series	FC 302 series
Parameter	522 Power, kW	16-10 Input Power [kW]

Table 5.198 Conversion of Parameter 522

	VLT 5000 series	FC 302 series
Parameter	523 Power, HP	16-11 Input Power [hp]

Table 5.199 Conversion of Parameter 523

**Parameter Mapping Lists**
**Operating Instructions**

	VLT 5000 series	FC 302 series
Parameter	524 Motor voltage	16-12 Motor Voltage

**Table 5.200 Conversion of Parameter 524**

	VLT 5000 series	FC 302 series
Parameter	525 DC link voltage	16-30 DC Link Voltage

**Table 5.201 Conversion of Parameter 525**

	VLT 5000 series	FC 302 series
Parameter	526 Motor temp.	16-18 Motor Thermal

**Table 5.202 Conversion of Parameter 526**

	VLT 5000 series	FC 302 series
Parameter	527 VLT® temp.	16-35 Inverter Thermal

**Table 5.203 Conversion of Parameter 527**

	VLT 5000 series	FC 302 series
Parameter	528 Digital input	16-60 Digital Input
Options	Term. 16 (binary 0000 0001)	Term. X30/2 (binary)
	Term. 17 (binary 0000 0010)	Term. X30/3 (binary)
	Term. 18 (binary 0000 0100)	Term. 18 (binary)
	Term. 19 (binary 0000 1000)	Term. 19 (binary)
	Term. 27 (binary 0001 0000)	Term. 27 (binary)
	Term. 32 (binary 0010 0000)	Term. 32 (binary)
	Term. 33 (binary 0100 0000)	Term. 33 (binary)

**Table 5.204 Conversion of Parameter 528**

	VLT 5000 series	FC 302 series
Parameter	529 Analogue input 53	16-62 Analog Input 53

**Table 5.205 Conversion of Parameter 529**

	VLT 5000 series	FC 302 series
Parameter	530 Analogue input 54	16-64 Analog Input 54

**Table 5.206 Conversion of Parameter 530**

	VLT 5000 series	FC 302 series
Parameter	531 Analogue input 60	16-64 Analog Input 54

**Table 5.207 Conversion of Parameter 531**

	VLT 5000 series	FC 302 series
Parameter	532 Pulse reference	16-51 Pulse Reference

**Table 5.208 Conversion of Parameter 532**

	VLT 5000 series	FC 302 series
Parameter	533 External reference %	16-50 External Reference

**Table 5.209 Conversion of Parameter 533**

	VLT 5000 series	FC 302 series
Parameter	534 Status word, binary	16-03 Status Word

**Table 5.210 Conversion of Parameter 534**

	VLT 5000 series	FC 302 series
Parameter	535 Brake power/2 min	16-33 Brake Energy /2 min

**Table 5.211 Conversion of Parameter 535**

	VLT 5000 series	FC 302 series
Parameter	536 Brake power/s	16-32 Brake Energy /s

**Table 5.212 Conversion of Parameter 536**

	VLT 5000 series	FC 302 series
Parameter	537 Heat sink temp	16-34 Heatsink Temp.

**Table 5.213 Conversion of Parameter 537**

	VLT 5000 series	FC 302 series
Parameter	538 Alarm word	14-72 Legacy Alarm Word

**Table 5.214 Conversion of Parameter 538**

	VLT 5000 series	FC 302 series
Parameter	539 VLT® Control word	16-00 Control Word

**Table 5.215 Conversion of Parameter 539**

	VLT 5000 series	FC 302 series
Parameter	540 Warning word	14-73 Legacy Warning Word

**Table 5.216 Conversion of Parameter 540**

	VLT 5000 series	FC 302 series
Parameter	541 Extended status word	14-74 Leg. Ext. Status Word

**Table 5.217 Conversion of Parameter 541**

	VLT 5000 series	FC 302 series
Parameter	553 Display text 1	Not converted

**Table 5.218 Conversion of Parameter 553**

	VLT 5000 series	FC 302 series
Parameter	554 Display text 2	Not converted

**Table 5.219 Conversion of Parameter 554**

	VLT 5000 series	FC 302 series
Parameter	557 Motor RPM	16-17 Speed [RPM]

**Table 5.220 Conversion of Parameter 557**

	VLT 5000 series	FC 302 series
Parameter	558 Motor RPM x scaling	Not converted

**Table 5.221 Conversion of Parameter 558**

	VLT 5000 series	FC 302 series
Parameter	580, 581, 582 Define parameter number	Not converted

**Table 5.222 Conversion of Parameter 580-582**

## 5.7 VLT® 5000 Parameter Group 6

	VLT 5000 series	FC 302 series
Parameter	600 Operating hours	15-00 Operating hours

**Table 5.223 Conversion of Parameter 600**

	VLT 5000 series	FC 302 series
Parameter	601 Hours run	15-01 Running Hours

**Table 5.224 Conversion of Parameter 601**

	VLT 5000 series	FC 302 series
Parameter	602 kWh counter	15-02 Input kWh Counter

**Table 5.225 Conversion of Parameter 602**

	VLT 5000 series	FC 302 series
Parameter	603 Numbers of power up	15-03 Power Up's

**Table 5.226 Conversion of Parameter 603**

	VLT 5000 series	FC 302 series
Parameter	604 Numbers of over temp.	15-04 Over Temp's

**Table 5.227 Conversion of Parameter 604**

	VLT 5000 series	FC 302 series
Parameter	605 Numbers of over voltage	15-05 Over Volt's

**Table 5.228 Conversion of Parameter 605**

	VLT 5000 series	FC 302 series
Parameter	606 Data log: Digital input	Not converted

**Table 5.229 Conversion of Parameter 606**

	VLT 5000 series	FC 302 series
Parameter	607 Data log: Bus commands	Not converted

**Table 5.230 Conversion of Parameter 607**

	VLT 5000 series	FC 302 series
Parameter	608 Data log: Status word	Not converted

**Table 5.231 Conversion of Parameter 608**

	VLT 5000 series	FC 302 series
Parameter	609 Data log: Reference	Not converted

**Table 5.232 Conversion of Parameter 609**

	VLT 5000 series	FC 302 series
Parameter	610 Data log: Feedback	Not converted

**Table 5.233 Conversion of Parameter 610**

**Parameter Mapping Lists**
**Operating Instructions**

	VLT 5000 series	FC 302 series
Parameter	611 Data log: Motor frequency	Not converted

**Table 5.234 Conversion of Parameter 611**

	VLT 5000 series	FC 302 series
Parameter	612 Data log: Motor voltage	Not converted

**Table 5.235 Conversion of Parameter 612**

	VLT 5000 series	FC 302 series
Parameter	613 Data log: Motor current	Not converted

**Table 5.236 Conversion of Parameter 613**

	VLT 5000 series	FC 302 series
Parameter	614 Data log: DC link voltage	Not converted

**Table 5.237 Conversion of Parameter 614**

	VLT 5000 series	FC 302 series
Parameter	615 Fault log: Error code	15-30 Alarm Log: Error Code

**Table 5.238 Conversion of Parameter 615**

	VLT 5000 series	FC 302 series
Parameter	616 Fault log: Time	15-32 Alarm Log: Time

**Table 5.239 Conversion of Parameter 616**

	VLT 5000 series	FC 302 series
Parameter	617 Fault log: Value	15-31 Alarm Log: Value

**Table 5.240 Conversion of Parameter 617**

	VLT 5000 series	FC 302 series
Parameter	618 Reset of kWh counter	15-06 Reset kWh Counter
Options	[0] No reset	[0] Do not reset
	[1] Reset	[1] Reset counter

**Table 5.241 Conversion of Parameter 618**

	VLT 5000 series	FC 302 series
Parameter	619 Reset of Hours run	15-07 Reset Running Hours Counter
Options	[0] No reset	[0] Do not reset
	[1] Reset	[1] Reset counter

**Table 5.242 Conversion of Parameter 619**

	VLT 5000 series	FC 302 series
Parameter	620 Operation mode	14-22 Operation Mode
Options	[0] Normal operation	[0] Normal operation
	[1] Function with deactivated inverter	Not supported
	[2] Control card test	[2] Control card test
	[3] Initialisation	[3] Initialisation

**Table 5.243 Conversion of Parameter 620**

	VLT 5000 series	FC 302 series
Parameter	621 Name plate: VLT® type	Not converted

**Table 5.244 Conversion of Parameter 621**

	VLT 5000 series	FC 302 series
Parameter	622 Name plate: Power section	Not converted

**Table 5.245 Conversion of Parameter 622**

	VLT 5000 series	FC 302 series
Parameter	623 Name plate: VLT® ordering no.	Not converted

**Table 5.246 Conversion of Parameter 623**

	VLT 5000 series	FC 302 series
Parameter	624 Name plate: Software version no.	Not converted

**Table 5.247 Conversion of Parameter 624**

	VLT 5000 series	FC 302 series
Parameter	625 Name plate: LCP ID no.	Not converted

**Table 5.248 Conversion of Parameter 625**

	VLT 5000 series	FC 302 series
Parameter	626 Name plate: Data base ID	Not converted

**Table 5.249 Conversion of Parameter 626**

	VLT 5000 series	FC 302 series
Parameter	627 Name plate: Power ID no.	Not converted

**Table 5.250 Conversion of Parameter 627**

	VLT 5000 series	FC 302 series
Parameter	628 Name plate: Application type	Not converted

**Table 5.251 Conversion of Parameter 628**

	VLT 5000 series	FC 302 series
Parameter	629 Name plate: Application type no.	Not converted

**Table 5.252 Conversion of Parameter 629**

	VLT 5000 series	FC 302 series
Parameter	630 Name plate: Com. type	Not converted

**Table 5.253 Conversion of Parameter 630**

	VLT 5000 series	FC 302 series
Parameter	631 Name plate: Com. Type no.	Not converted

**Table 5.254 Conversion of Parameter 631**

## 5.8 VLT® 5000 Parameter Group 7

	VLT 5000 series	FC 302 series
Parameter	700 System control	8-02 Control Source 33-82 Drive Status Monitoring
Options	[0] Enable SyncPos	Par. 8-02: [5] Option C0 Par. 33-82: [1] On
	[1] Disable SyncPos	Par. 8-02: [1] FC RS-485
	[2] Enable SyncPos without VLT monitoring	Par. 8-02: [5] Option C0 Par. 33-82: [0] Off

**Table 5.255 Conversion of Parameter 700**

	VLT 5000 series	FC 302 series
Parameter	701 Program number	33-80 Activated Program Number
Options	-1 – 127	-1 – 127

**Table 5.256 Conversion of Parameter 701**

	VLT 5000 series	FC 302 series
Parameter	702 PID Proportional factor	32-60 Proportional factor
Options	0 – 65000	0 – 100000

**Table 5.257 Conversion of Parameter 702**

	VLT 5000 series	FC 302 series
Parameter	703 PID Derivative factor	32-61 Derivative factor
Options	0 – 65000	0 – 100000

**Table 5.258 Conversion of Parameter 703**

	VLT 5000 series	FC 302 series
Parameter	704 PID Integral factor	32-62 Integral factor
Options	0 – 65000	0 – 100000

**Table 5.259 Conversion of Parameter 704**

	VLT 5000 series	FC 302 series
Parameter	705 PID Integral bandwidth	32-63 Limit Value for Integral Sum
Options	0 – 1000	0 – 1000

**Table 5.260 Conversion of Parameter 705**

	VLT 5000 series	FC 302 series
Parameter	706 PID Active bandwidth	32-64 PID Bandwidth
Options	0 – 65000	0 – 1000

**Table 5.261 Conversion of Parameter 706**

	VLT 5000 series	FC 302 series
Parameter	707 PID Velocity Feed-forward	32-65 Velocity Feed-Forward
Options	0 – 65000	0 – 100000

Table 5.262 Conversion of Parameter 707

	VLT 5000 series	FC 302 series
Parameter	708 PID Acceleration Feed-forward	32-66 Acceleration Feed-Forward
Options	0 – 65000	0 – 100000

Table 5.263 Conversion of Parameter 708

	VLT 5000 series	FC 302 series
Parameter	709 PID Velocity filter	33-26 Velocity Filter
Options	-500000 – 500000	-1073741824 – 107374203

Table 5.264 Conversion of Parameter 709

	VLT 5000 series	FC 302 series
Parameter	710 - 779	19-10 -19-79
Options	User defined	User defined

Table 5.265 Conversion of Parameters 710 to 779

	VLT 5000 series	FC 302 series
Parameter	780 Dead time compensation	Not supported
Options	[0] Off	
	[1] On	

Table 5.266 Conversion of Parameter 780

	VLT 5000 series	FC 302 series
Parameter	781 Program ID	Not supported
Options	0 – 65000	

Table 5.267 Conversion of Parameter 781

	VLT 5000 series	FC 302 series
Parameter	795 - 799 User defined (read only)	19-95 -19-99 User defined (read only)
Options	User defined	User defined

Table 5.268 Conversion of Parameters 795 to 799

## 5.9 VLT® 5000 Parameter Group 8

	VLT 5000 series	FC 302 series
Parameter	801 Baud rate selection	Not converted

Table 5.269 Conversion of Parameter 801

	VLT 5000 series	FC 302 series
Parameter	802 Minimum station delay	Not converted

Table 5.270 Conversion of Parameter 802

	VLT 5000 series	FC 302 series
Parameter	803 Time out after bus error	8-03 Control Timeout Time
Range	1 – 99	0.1 – 18000.0

Table 5.271 Conversion of Parameter 803

	VLT 5000 series	FC 302 series
Parameter	804 Response after bus time out	8-04 Control Timeout Function 8-02 Control Word Source
Range	[0] Off	[0] Off
	[1] Freeze output frequency	[1] Freeze output frequency
	[2] Stop	[2] Stop
	[3] Jogging	[3] Jogging
	[4] Max speed	[4] Max speed
	[5] Stop and trip	[5] Stop and trip
	[6] No com. option control	Par. 802 to RS485
	[7] Select set up 4	[10] Select set up 4

Table 5.272 Conversion of Parameter 804

	VLT 5000 series	FC 302 series
Parameter	805 Function of control word bit 10	8-14 Configurable Control Word CTW
Range	[0] No function	[0] None
	[1] Bit 10 = 1 => CTW active	[1] Profile default
	[2] Bit 10 = 0 => CTW active	[2] CTW Valid, active low
	[3] Bit 10 = 1 => Time out	[1] Profile default

Table 5.273 Conversion of Parameter 805

## 5.10 VLT® 5000 Parameter Group 9

	VLT 5000 series	FC 302 series
Parameter	904 PPO type select for DP	Not converted

Table 5.274 Conversion of Parameter 904

	VLT 5000 series	FC 302 series
Parameter	915 PCD config write	9-15 PCD Write Configuration
Options	[0] None	[0] None
[204] Minimum Reference	[302] Minimum Reference	
[205] Maximum Reference	[203] Maximum Reference	
[219] Catch up/slow Down Value	[312] Catch up/slow Down Value	
[207] Ramp 1 Ramp up Time	[341] Ramp 1 Ramp up Time	
[208] Ramp 1 Ramp Down Time	[342] Ramp 1 Ramp Down Time	
[209] Ramp 2 Ramp up Time	[351] Ramp 2 Ramp up Time	
[210] Ramp 2 Ramp down Time	[352] Ramp 2 Ramp down Time	
[211] Jog Ramp Time	[380] Jog Ramp Time	
[212] Quick Stop Ramp Time	[381] Quick Stop Ramp Time	
[201] Motor Low Limit [Hz]	[412] Motor Speed Low Limit [Hz]	
[202] Motor High Limit [Hz]	[414] Motor Speed High Limit [Hz]	
[221] Torque Limit Motor Mode	[416] Torque Limit Motor Mode	
[222] Torque Limit Generator Mode	[417] Torque Limit Generator Mode	
[509] Bus Jog 1 Speed	[890] Bus Jog 1 Speed	
[510] Bus Jog 2 Speed	[891] Bus Jog 2 Speed	
Comments	VLT® 5000 supports more write signals. If a not-supported signal is written then the corresponding signal is set to [0] None.	

Table 5.275 Conversion of Parameter 915

	VLT 5000 series	FC 302 series
Parameter	916 PCD config read	9-16 PCD Read Configuration
Options	[0] None	[0] None
[538] Alarm word	[1472] VLT Alarm Word	
[540] Warning word	[1473] VLT Warning Word	
[541] Ext. status word	[1474] VLT Ext. status Word	
[600] Operating hours	[1500] Operating hours	
[601] Running hours	[1501] Running hours	
[602] kWh Counter	[1502] kWh Counter	
[539] Control word	[1600] Control word	
[516] Reference [Unit]	[1601] Reference [Unit]	
[515] Reference %	[1602] Reference %	
[534] Status word	[1603] Status word	
[522] Power [kW]	[1610] Power [kW]	
[523] Power [HP]	[1611] Power [HP]	
[524] Motor voltage	[1612] Motor voltage	
[518] Motor frequency	[1613] Motor frequency	
[520] Motor current	[1614] Motor current	
[557] Motor RPM	[1617] Motor speed	
[526] Motor thermal	[1618] Motor thermal	
[521] Torque	[1622] Torque %	
[525] DC link voltage	[1630] DC link voltage	
[536] Brake energy/s	[1632] Brake energy/s	
[535] Brake energy/2 min	[1633] Brake energy/2 min	
[537] Heat sink temp.	[1634] Heat sink temp.	
[527] Inverter Thermal	[1635] Inverter Thermal	
[533] External reference	[1650] External reference	
[532] Pulse reference	[1651] Pulse reference	
[517] Feedback [Unit]	[1652] Feedback [Unit]	
[528] Digital input	[1660] Digital input	
[529] Analog input 53	[1662] Analog input 53	
[530] Analog input 54	[1664] Analog input 54	
[531] Analog input 60	[1664] Analog input 54	

Table 5.276 Conversion of Parameter 916

	VLT 5000 series	FC 302 series
Parameter	918 Station address	10-02 MAC ID
Range	0 - 63	0 - 63

Table 5.277 Conversion of Parameter 918

	VLT 5000 series	FC 302 series
Parameter	927 Parameter edit	9-27 Parameter Edit
Options	[0] Disable	[0] Disable
[1] Enable	[1] Enable	

Table 5.278 Conversion of Parameter 927

	VLT 5000 series	FC 302 series
Parameter	928 Control authority	9-28 Process Control
Options	[0] Disable	[0] Disable
	[1] Enable	[1] Enable cyclic master

**Table 5.279 Conversion of Parameter 928**

	VLT 5000 series	FC 302 series
Parameter	953 Warning parameter	9-53 Profibus Warning Word

**Table 5.280 Conversion of Parameter 953**
**5**

	VLT 5000 series	FC 302 series
Parameter	967 Control word	Not converted

**Table 5.281 Conversion of Parameter 967**

	VLT 5000 series	FC 302 series
Parameter	968 Status word	Not converted

**Table 5.282 Conversion of Parameter 968**

	VLT 5000 series	FC 302 series
Parameter	970 Parameter set-up selection	9-70 Edit Set-up
Options	[0] Factory setting	[0] Factory setting
	[1] Parameter setup 1	[1] Parameter setup 1
	[2] Parameter setup 2	[2] Parameter setup 2
	[3] Parameter setup 3	[3] Parameter setup 3
	[4] Parameter setup 4	[4] Parameter setup 4
	[5] Active setup	[9] Active setup

**Table 5.283 Conversion of Parameter 970**

	VLT 5000 series	FC 302 series
Parameter	971 Save data values	9-71 Profibus Save Data Values
Options	Unsigned 8 (5)	Unsigned 8 (5)
	[0] Not active	[0] Off
	[1] Save active setup	[1] Store all setups
	[2] Save edit setup	[1] Store all setups
	[3] Save all setups	[1] Store all setups

**Table 5.284 Conversion of Parameter 971**

	VLT 5000 series	FC 302 series
Parameter	980, 981, 982, 990 Modified parameters	Not converted

**Table 5.285 Conversion of Parameter 980-990**

## 6 Troubleshooting

### 6.1 Step-by-step Troubleshooting

1. Copy the station address from the VLT® 5000 to the VLT® AutomationDrive.
2. Cycle power to the FC 302.
3. The master/PLC now recognises FC 302 as a VLT® 5000.
4. The NS LED on the MCA 194 option is now solid green indicating that communication between master and slave is established.

If the NS LED flashes, the master/PLC has not recognised the FC 302 action:

- Check if station address is the same in the FC 302 as the replaced VLT® 5000.
- Check *10-01 Baud Rate Select*. If the frequency converter has no connection to the master, this parameter may be set to the wrong baudrate.
- Check *10-13 Warning Parameter*.

Bit	Warn. Word [Hex]	Description
0	0001	Bus not active
1	0002	Explicit connection timeout
2	0004	I/O connection
3	0008	Retry limit reached
4	0010	Actual value is not updated
5	0020	CAN bus off
6	0040	I/O send error
7	0080	Initialisation error
8	0100	No bus supply
9	0200	Bus off
10	0400	Error passive
11	0800	Error warning
12	1000	Duplicate MAC ID Error
13	2000	RX queue overrun
14	4000	TX queue overrun
15	8000	CAN overrun

Table 6.1 Warning Word

- Check *chapter 1.4 Constraints* for more information on limitations.

## **Index**

### **A**

Abbreviation..... 5

Additional resources..... 3

### **B**

Brake resistor..... 3

### **C**

Commissioning..... 12

Configuration..... 3

Constraint..... 3

### **D**

DIP switch..... 11

### **E**

EMC precautions..... 10

### **H**

Hardware..... 4

High voltage..... 6

### **I**

Installation..... 8

### **L**

LED..... 12

Linked set-up..... 5

Literature..... 3

### **M**

MCA 194..... 43

Mechanical installation..... 9

### **P**

Parameter (mapping list)..... 14

Performance..... 5

Power size..... 3

Product overview..... 3

### **Q**

Qualified personnel..... 6

### **S**

Set-up, linked..... 5

### **T**

Terminal..... 4

Troubleshooting..... 43

### **W**

Warning word..... 43





[www.danfoss.com/drives](http://www.danfoss.com/drives)

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequent changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.

Danfoss A/S  
Ulsnaes 1  
DK-6300 Graasten  
[www.danfoss.com/drives](http://www.danfoss.com/drives)