








Installation guide

Solenoid coil for control in potentially explosive areas

Type BZ

018R9667

018R9667

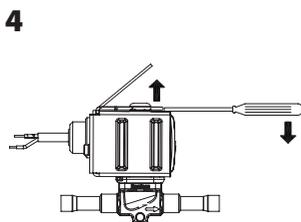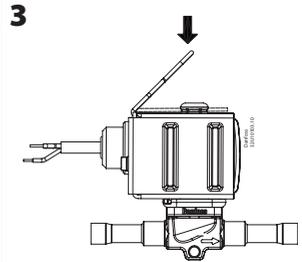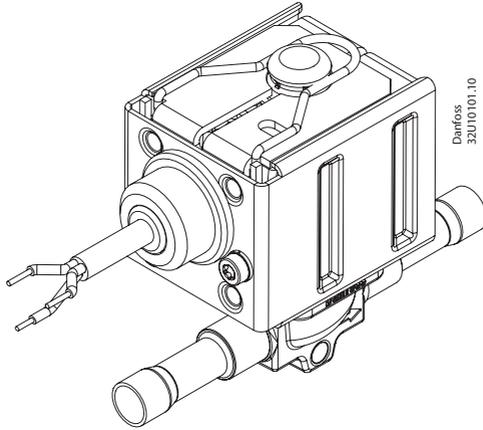


(A)

Danfoss
 MADE IN CHINA
 Type BZ120C
 Spare part no. 018F4703

Tambient -40T45 °C
 110V 50HZ 0,14A
 120V 60HZ 0,13A


CCC F4753
 Danfoss A/S, 6430 Nordborg, Denmark
 22 Wycombe End, HP9 1NB, GB




CE 0539 Ex II 2G CA 0843
 Ex mb IIC T4 Gb
 DEMKO 14 ATEX 1314X
 IECEx ULD.14.0001X
 UL21UKEX2020X

Warnings
 Do not separate coil from the valve when energized.
 See instruction

② Date of manufacturing



(B)

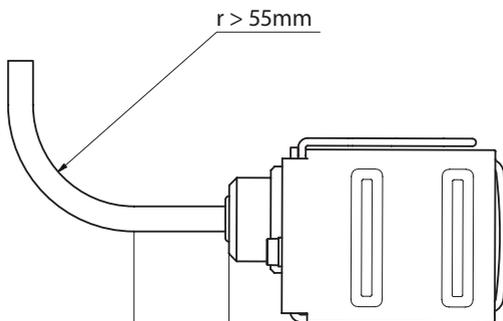

The installer must fix the cable in a position close to the coil to ensure that the first 20 mm cannot be bent.

A Identification

- ① Green/Yellow cord for earthing
- ② Week and year of manufacturing
- ③ External earth terminal
- ④ Code number
- ⑤ Voltage
- ⑥ Frequency
- ⑦ Current
- ⑧ Ambient temperature range
- ⑨ Country of manufacturing
- ⑩ Enclosure
- ⑪ Approval/Certificate number

Description and approval

Solenoid valve for control in potentially explosive area.

EU Directives

EMC 2014/30/EU
ROHs 2011/65/EU
ATEX 2014/34/EU

Certifications

Ex mb IIC T4 Gb
DEMKO 14 ATEX 1314X
IECEx ULD 14.0001X
UL21UKEX2020X

The coil may only be installed with following valve combinations

- EVR NC 2 - 25
- EVRA(T) 3 - 25
- EVRS(T) 3 - 20
- EVRB
- EVRF
- EVM NC and EVM NO
- EV220B 6 - 22 NC
- EV220B 6 - 10 NO
- EV220B 15 - 50 NC
- EV250B
- EV251B
- EV222B
- EV224B
- EV227B

Application and specification

Nominal voltage	Frequency	Nominal current	Size of fuse in front of the coil	Ambient temperature	Media temperature	Permissible voltage variation	Code no.
[V]	[Hz]	[A]	[mA]	[°C]	[°C]	[%]	
24	DC	0.43	500	-40 – 45	-40 – 70	-10 – +5	018F4705
110 120	50 60	0.14 0.13	250	-40 – 45	-40 – 70	-10 – +6	018F4703
230 240	50 60	0.09 0.08	150	-40 – 45	-40 – 70	-10 – +6	018F4704

Ambient temperature	-40 – 45 °C	Protection degree	1+2+3 (EN60730-1)
Media temperature	-40 – 70 °C	Over voltage category	III (EN60730-1)
Humidity	0% < RH < 100%	Mode of operation	Type 1 action (EN60730-1)
Connection	3-core flexible cable 3 x 0.75 mm ²	Type of control	Incorporated control (EN60730-1)
External earth core	Minimum area > 4 mm ²	Protection against electrical shock	Class I (EN60730-1)
Weight exclude valve	0.4 kg exclude cable	Protection degree	IP65 (IEC 60529)

Safety instruction

All national safety regulations must be complied with in connection with installation, start-up and operation of Danfoss solenoid valve. Furthermore, the requirements of the declaration of conformity and national regulations for installation in explosion area. Disregarding such regulations involves a risk of serious personal injury or extensive material damage. Work in connection with the solenoid valve mentioned must be performed only by suitable qualified persons.

Safety requirements for use in explosive atmospheres are fulfilled through compliance certificates:

- EX mb IIC T4 Gb
- DEMKO 14 ATEX 1314X
- IECx ULD 14.0001X
- UL21UKEX2020X

Installation, operation and maintenance

- Protect the coil against external impact
- Protect the coil against direct sunlight and other ultraviolet sources
- Disconnect the power before dismantling the coil
- An external fuse (standard DIN41571-2) is required to protect coils as follows:
 018F4703: 250 mA, 1500 A Breaking capacity, 250 V, Medium Time lag
 018F4704: 150 mA, 1500 A Breaking capacity, 250 V, Medium Time lag
 018F4705: 500 mA, 1500 A Breaking capacity, 250 V, Medium Time lag
 The Power supplying the solenoid must be limited to a prospective short circuit current of a maximum 1500 A
- Install the coil and cable according to IEC/EN/ EN BS 60079-14
- The cable supplied with the solenoids must not be handled or flexed, and shall be protected against impact if the ambient temperature is below 0 °C

- Installation and handling of the cable shall be done at temperature above 0 °C
- The cable is only for fixed installation and the minimum bending diameter for fixed installation: $r \geq 55 \text{ mm}$ (Ⓢ)
- The cable jacket material is PVC
- The cable operating temperature range is -40 – 90 °C
- The product is provided with a yellow/green PE wire as well as an external earth terminal. These shall not be used simultaneously.
 If the external earth connection is connected to earth or bonding system, the Y/G earth wire must be cut off, isolated and not connected. If the Y/G wire is connected to earth, the external earth terminal must be left without any connection. For the external earth terminal the size of the earth core shall be minimum 4 mm² and the installer shall use a suitable method e.g. crimp terminal to ensure secureness of the external earth connection. The screw for external PE shall be mounted with 1.2 Nm ± 0.2. The external earth conductors shall be physically secured close to the coil connection to ensure that the conductors cannot be readily loosened or twisted
- The end user must ensure the earthing of the coil is maintained
- Non-detachable cords method Z repairing not allowed. If the coil failed, it must be replaced by a new coil

UK-CA contact address:
Danfoss Ltd.
22 Wycombe End,
HP9 1NB, GB

CE contact address:
Danfoss A/S
DK-6430 Nordborg
Denmark