


ENGINEERING
TOMORROW



Operating Guide

Line Voltage Measurement

VACON® NX AC Drives OPTD7 Option Board

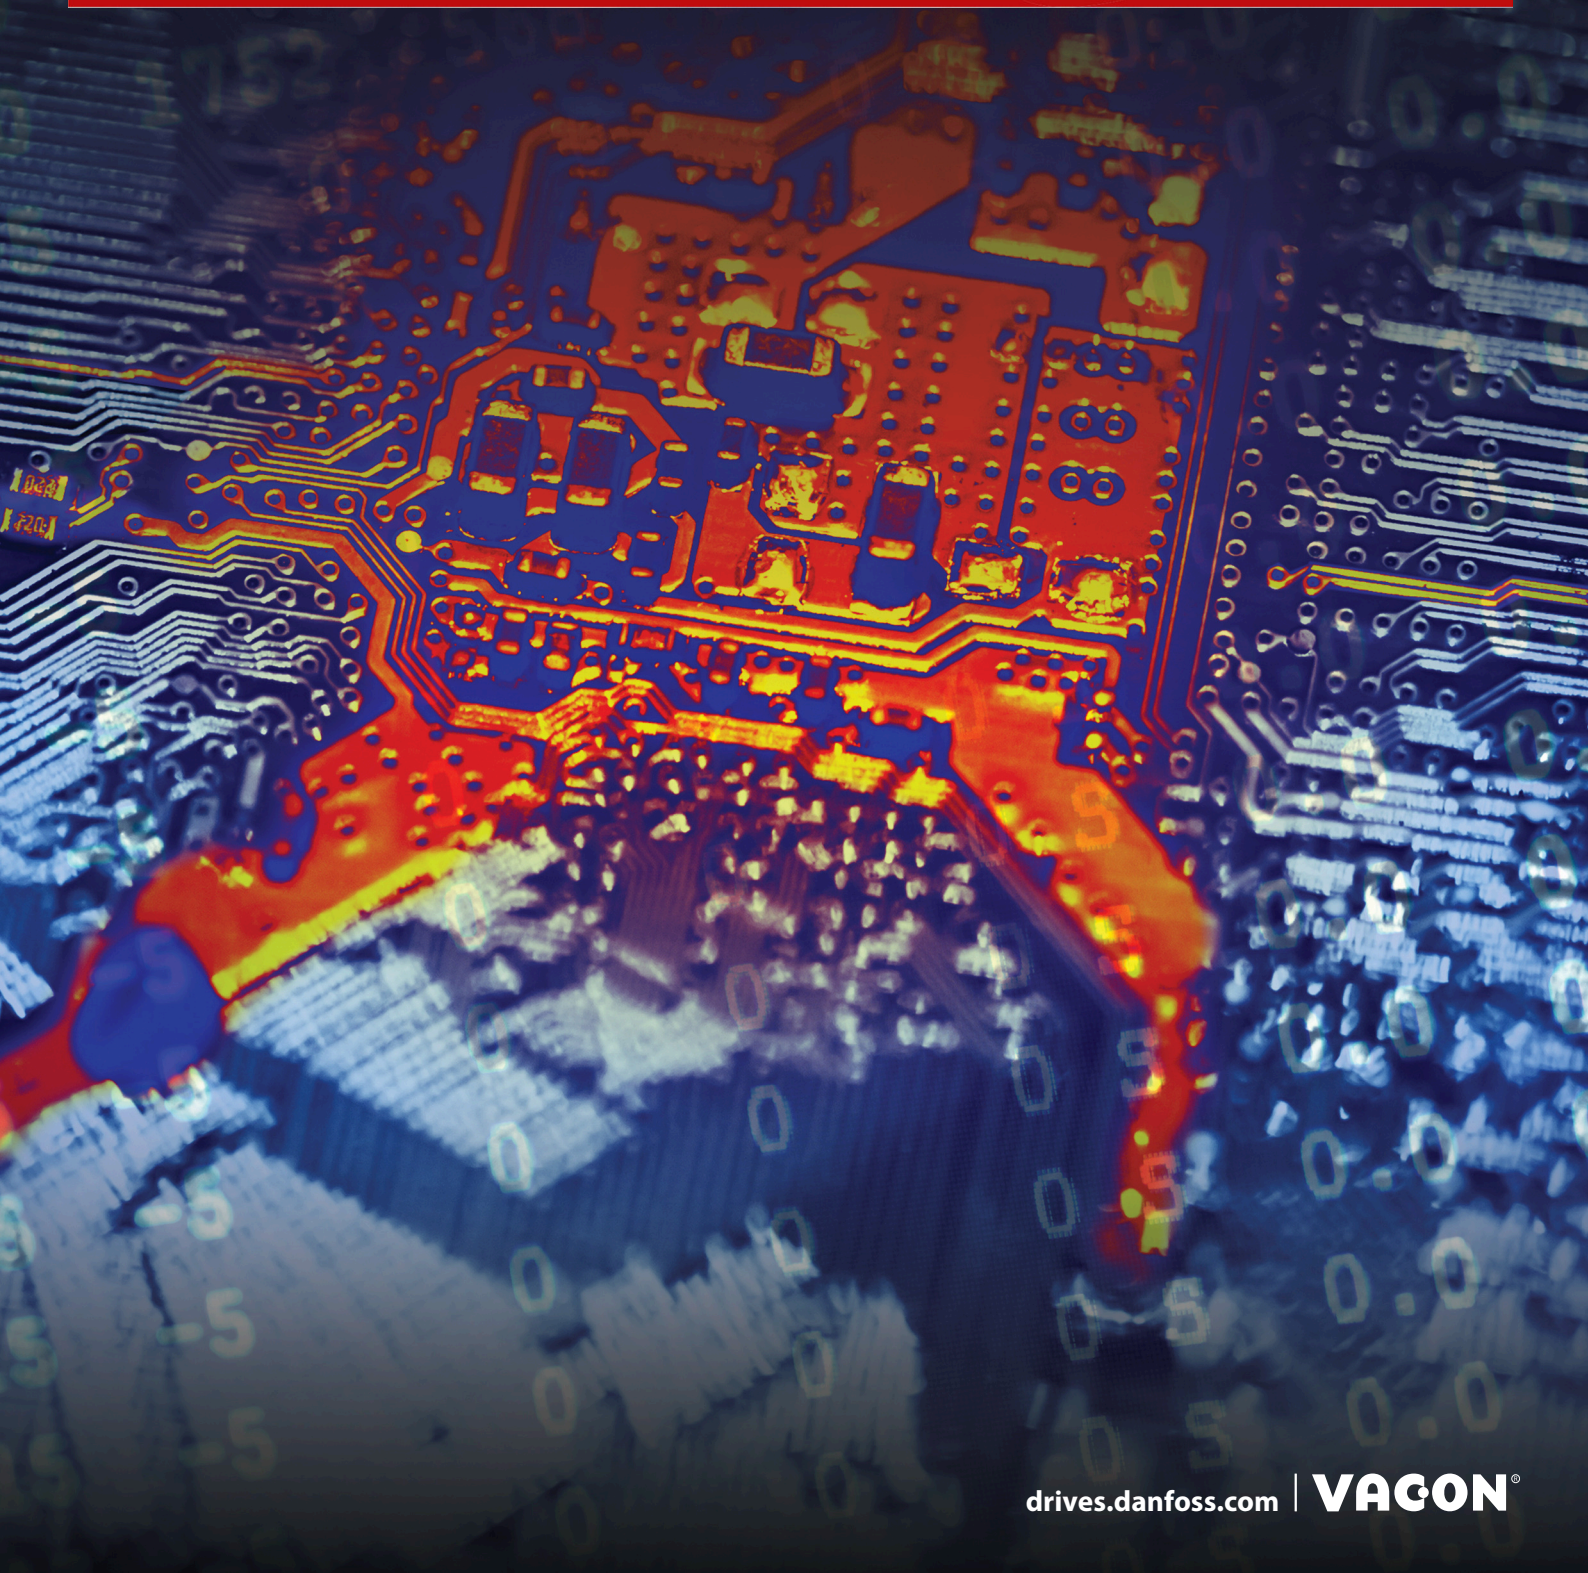

Contents

1	Introduction	4
1.1	Purpose of the Operating Guide	4
1.2	Additional Resources	4
1.3	Disposal	4
2	Product Overview	5
2.1	Intended Use	5
2.2	Specification	6
3	OPTD7 Option Board Menu	7
3.1	Parameters	7
3.2	Monitoring	7
4	Application Examples	8
4.1	Line Synchronization	8
4.2	Fundamental Front End (NXF)	9

1 Introduction

1.1 Purpose of the Operating Guide

This operating guide provides the information on the VACON® NX Line Voltage Measurement OPTD7 Option Board used in VACON® NXP drives. It is intended for qualified personnel.

Read and follow the instructions to use the drive safely and professionally.

1.2 Additional Resources

Other resources are available to understand advanced AC drive functions and programming.

- The VACON® NX manuals provide greater detail on working with parameters and show many application examples.
- The VACON® NX I/O Boards User Manual gives more information on the I/O boards and their installation.
- Instructions for operation with option boards and other optional equipment.

Supplementary publications and manuals are available from Danfoss.

1.3 Disposal

Do not dispose of equipment containing electrical components together with domestic waste. Collect it separately in accordance with local and currently valid legislation.



2.1 Intended Use

The OPTD7 option board is delivered with the transformer which is suitable for voltage range 380-690 V.



NOTE! The transformer can not be used with the pulse width modulated (PWM) voltage input.

NOTICE

The OPTD7 option board can only be used in slot C of VACON® NXP drive.

AQ442338036238en-000201 / UD01056 | 5

2.2 Specification

Table 1: OPTD7 Option Board (VB00379 based on revision X)

Technical item or function	Technical data	Description
Transformer primary/input voltage range	Min 380 V AC -15% Max 690 V AC +15%	
Transformer ratio primary:secondary	60:1	
Transformer secondary/output voltage range	14 V rms	Between the terminals L1/L2/L3
Input impedance	L1/L2 = 50 k Ω L1/L3 = 25 k Ω L2/L3 = 25 k Ω	L3 is internal virtual common
Cable recommendation	Max 1.5 mm ² , shielded	From transformer output to OPTD7 option board
Measurement resolution	10 bit	
Voltage measurement accuracy	0.2%	For D7 board measurement, transformer not included
Frequency measurement accuracy	Accuracy: <10 mHz Resolution: 10 mHz	In frequency range 45-65 Hz

3 OPTD7 Option Board Menu

3.1 Parameters

- Transformer ratio: Transfer ratio of the measurement transformer.
- Default value: 60.00(690 V/11.5 V)

In case using other measurement transformers than the one supplied with the board, the voltage measurement shows correct numbers by setting the transformer ratio right.

3.2 Monitoring

- Line voltage: Main voltage
- Line frequency: Main frequency(including sign)

4 Application Examples

4.1 Line Synchronization

Features:

- Frequency and phase angle synchronization between VACON® NXP drive and mains supply. Thus smooth Direct On Line (DOL) transfer of motor to the mains is possible with minimal peak current from the mains supply.
- External synchronizer is not required.
- Smooth transfer back to inverter with fast catch on fly feature.
- Changeover activation possible through either I/O, fieldbus or keypad.
- Compensation parameters for the changeover circuit delay and offset angle to the synchronization.
- Indication for 'Line Synch OK' programmable to digital outputs.
- Mains voltage and frequency monitoring on keypad and PC tool.
- Applicable to any size of LV (low voltage) motor and MV (medium voltage) motor through step up transformer.
- OPTD7 option board is used for mains supply voltage measurement as shown in [Illustration 3](#).

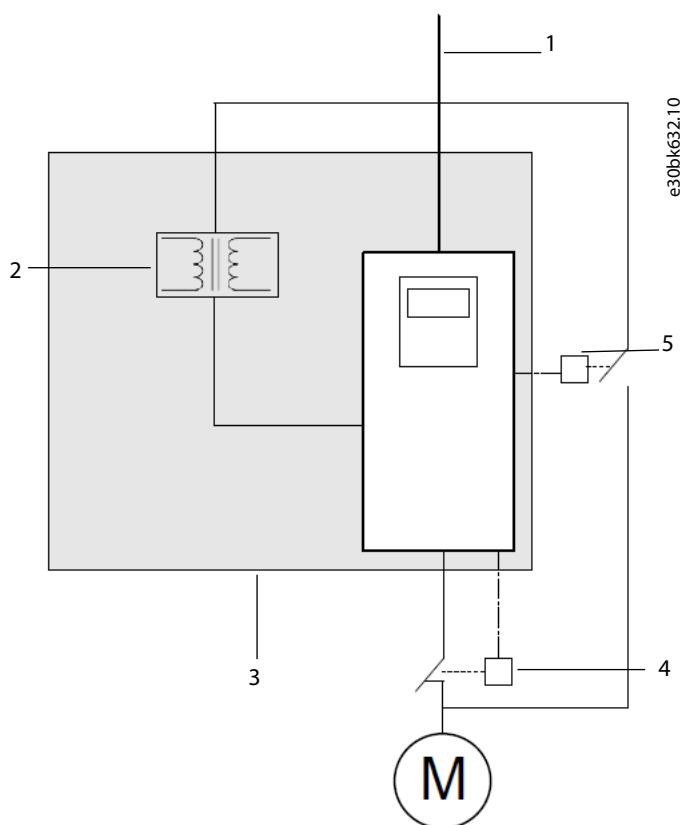


Illustration 3: Block Diagram for Direct ON Line Transfer of Motor

1	Mains supply	4	Drive contactor
2	Measurement transformer	5	Bypass contactor
3	VACON AC drive		

See [Illustration 4](#) for the connection diagram example for OPTD7 option board and voltage transformer in Line Synchronization applications.

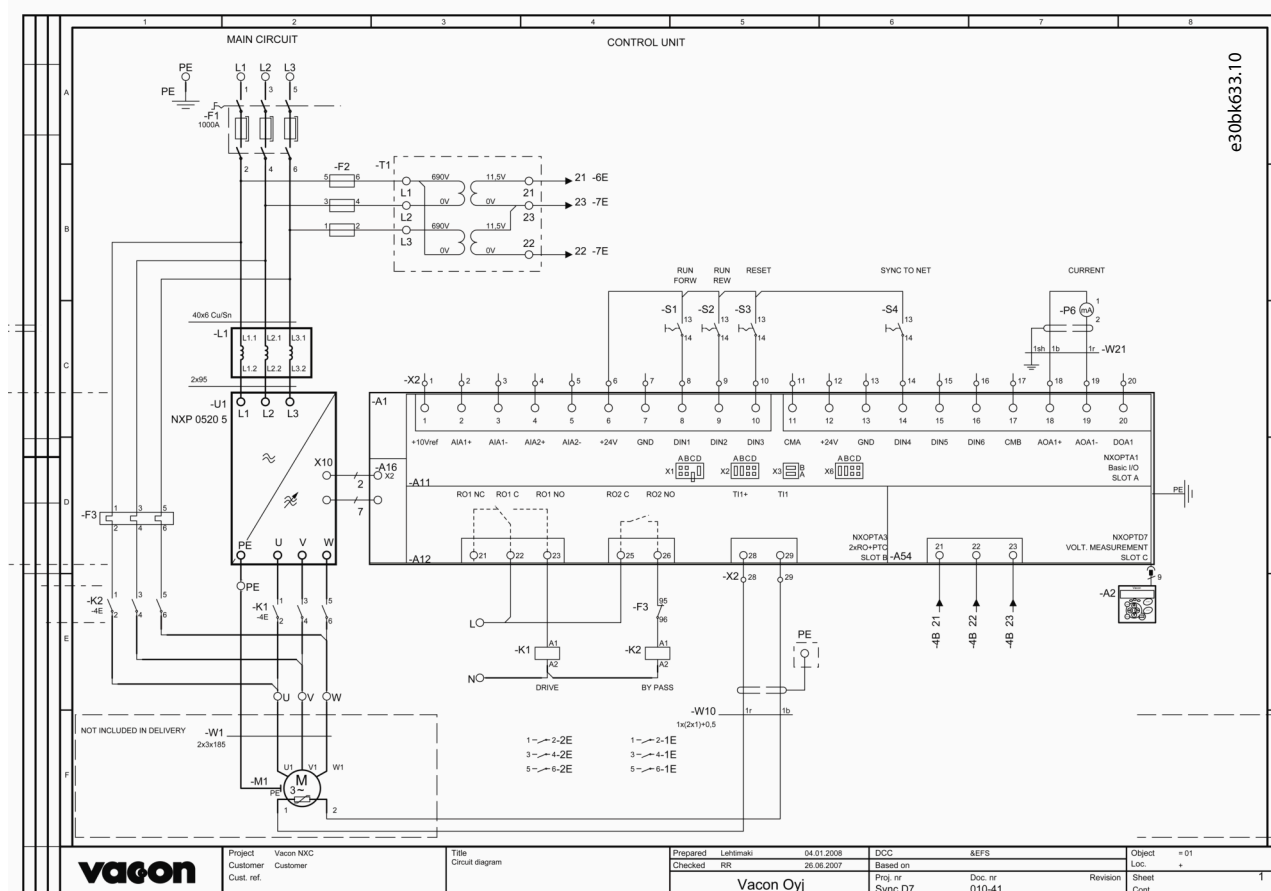


Illustration 4: Connection in Line Synchronization Applications

4.2 Fundamental Front End (NXF)

OPTD7 option board is used to feedback the main supply voltage and frequency with VACON® NXF, fundamental front end. Fundamental front end is IGBT based regenerative supply unit. It is used to supply one or multiple inverters in a common DC bus system. For more details, please refer to www.danfoss.com or contact Danfoss Sales Support.

See the connection of OPTD7 option board and voltage transformer in FFE applications in [Illustration 5](#).




Illustration 5: Connection in FFE Applications

Index

A

Application programming tool.....5

D

DC bus system.....9

Default value..... 7

Direct On Line..... 8

Disposal..... 4

I

Input voltage..... 5

L

Line frequency..... 7

Line voltage..... 7

Low voltage..... 8

M

Mains voltage..... 8

Medium voltage..... 8

O

Output voltage..... 5

Q

Qualified personnel.....4

T

Transformation ratio.....5

Transformer ratio..... 7

V

Voltage input.....5

Voltage range.....5

Voltage transformer.....9

ENGINEERING
TOMORROW

Danfoss

**Vacon Ltd, Member of the
Danfoss Group**
Runsorintie 7
FIN-65380 Vaasa
www.danfoss.com

Danfoss can accept no responsibility for possible errors in catalogs, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.

