

Data Sheet

Danfoss Redia® thermostatic sensors series

Application



The Danfoss Redia[®] series is a comprehensive portfolio of premium quality thermostatic sensors, produced in Denmark.

The Danfoss Redia[®] thermostat uses liquidfilled technology, that gives fast reaction time and compact sensor size to fit most applications.

The Danfoss Redia[®] thermostat is installed onto a radiator valve. The combination of the thermostat and radiator valve, controls the individual room temperature at a given setpoint by adjusting the flow of hot water through the radiator.

The Danfoss Redia[®] thermostat is applicable to all types of heating applications, including applications with small calculated P-band.



Danfoss Redia[®] series includes:

- Standard thermostats with built-in or remote sensor
- Variants with connection for radiator valves and radiators with integrated valves, type Danfoss RA
- Variants with M30x1.5 connection for radiator valves and radiators with integrated valves
- Variants with connection for Danfoss valves, type Danfoss RTD
- Variants with M28x1.0 connection for Herz radiator valves

Features:

- Liquid-filled thermostat with precise temperature control
- Fast reaction time in thermostatic sensor category
- Highest-class Control Accuracy (CA 0.2 K) per amended EN215
- Danfoss RA Click mount fast, save, tool-less
- Modern and user-friendly design
- Easy to operate, easy to clean
- Facilities designed for the visually impaired
- Facilities for limiting and locking temperature set-point
- Frost protection setting
- A theft protection, from factory or available as accessory

All Danfoss radiator thermostats are manufactured in factories, assessed and certified by by BVC (Bureau Veritas Certification) against ISO 9001 and ISO 14001.

Quality



Danfoss Redia[®] thermostatic sensors are certified according to the European standard EN 215.





DatasheetDanfoss Redia® Thermostatic sensors series

Technical data

| Туре | Sensor | Response time | Differential pressure influence (D) | Hysteresis (C) | Water temperature influence (W) | Control Accuracy (CA) |
|-----------|----------|----------------------|---|----------------|---------------------------------------|--------------------------|
| Redia RA | Built-in | 18 mins | 0.10 K | 0.20 K | 0.68 K | 0.2 K |
| Redia RA | Remote | 22 mins | 0.10 K | 0.20 K | 0.40 K | 0.2 K |
| Redia M30 | Built-in | 18 mins | 0.10 K | 0.40 K | 0.48 K | 0.2 K |

Ordering and Specification

| Туре | Model | Sensor | Cap. tube | Set point range | Connection | Zero blocking | Limiter pins | Theft protec- tion | EN215 Certified | Code no. |
|------------|------------|----------|--------------|-----------------------|------------|------------------|-----------------|--------------------------|--------------------|----------|
| Redia RA | Standard | Built-in | | 8-28°C | RA | | ✓ | | ✓ | 015G3390 |
| Redia RA | Standard | Built-in | | 8-28°C | RA | ✓ | ✓ | | ✓ | 015G3398 |
| Redia RA | Standard | Built-in | | 8-28°C | RA | ✓ | ✓ | | ✓ | 015G3898 |
| Redia RA | Standard | Built-in | | 8-28°C | RA | | ~ | √ | ✓ | 015G3380 |
| Redia RA | Standard | Built-in | | 8-28°C | RA | ✓ | ✓ | √ | ✓ | 015G3388 |
| Redia RA | Standard | Remote | 0-2 m | 8-28°C | RA | | ~ | | ✓ | 015G3392 |
| Redia RA | Standard | Remote | 0-2 m | 8-28°C | RA | | ~ | √ | ✓ | 015G3382 |
| Redia RA | Limited | Built-in | | 16-28°C | RA | | ✓ | | ✓ | 015G3396 |
| Redia RA | Limited | Built-in | | 16-28°C | RA | | ~ | | ✓ | 015G5334 |
| Redia RA | Limited | Built-in | | 8-19,5°C | RA | | ~ | √ | | 015G5320 |
| Redia RA | Limited | Built-in | | 8-21°C | RA | | ✓ | √ | ✓ | 015G5421 |
| Redia RA | Limited | Built-in | | 8-22°C | RA | | ~ | √ | ✓ | 015G5422 |
| Redia RA | Limited | Built-in | | 8-23°C | RA | | ~ | √ | ✓ | 015G5423 |
| Redia RTD | Service | Built-in | | 8-28°C | RTD | ✓ | ✓ | | | 015G3350 |
| Redia RTD | Serv. /Ltd | Built-in | | 16-28°C | RTD | | ~ | | | 015G3356 |
| Redia M30 | Standard | Built-in | | 8-28°C | M30x1.5 | | ✓ | | | 015G3330 |
| Redia M30 | Standard | Built-in | | 8-28°C | M30x1.5 | ✓ | ✓ | | | 015G3338 |
| Redia M30 | Standard | Built-in | | 8-28°C | M30x1.5 | \checkmark | \checkmark | | ✓ | 015G3339 |
| Redia M30 | Standard | Remote | 0-2 m | 8-28°C | M30x1.5 | | ✓ | | | 015G3332 |
| Redia M30 | Limited | Built-in | | 16-28°C | M30x1.5 | | ✓ | | | 015G3336 |
| Redia Herz | Standard | Built-in | | 8-28°C | M28x1.5 | | ~ | | | 015G3337 |

Accessories

| Accessories | | Code no. |
|-------------|--|----------|
| | Anti-theft plug for snap-lock sensors, white (20 pcs.) | 013G5245 |
| | Blocking pin (130 pcs.) | 013G5199 |
| -00 | Toolkit comprising Allen key & locking pin tool | 013G1236 |
| 0 | Theft protection for M30 sensors (10 pcs.) | 013G5287 |
| (tr 1) | Partner clip | 015G3900 |






Datasheet Danfoss Redia[®] Thermostatic sensors series

Accessories (Cont.)

| e e | Angle adapter for Danfoss RA sensors | 013G1350 |
|-----|--|----------|
| E. | Angle adapter for M30 x 1.5 connection | 013G1360 |

Construction

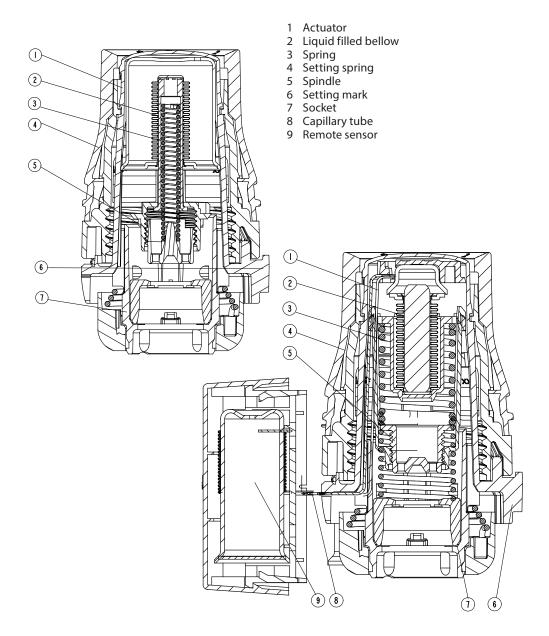

Operating Principle

Thermostatic sensors are proportional controls, regulating the heat supply in relation to the difference between the temperature set on the sensor and the temperature of ambient air, detected by the thermostat.

The thermal expansion element (bellow) responds to room temperature by expanding or contracting proportionally. The movement is transmitted onto the control element of the thermostatic valve. The thermostatic sensor controls the amount of water which flows into radiator to the suitable flow level that is required to maintain the room temperature on the set level.

Danfoss Redia[®] series of thermostatic sensors are fitted with liquid-filled bellows, ensuring fast response time to changing ambient temperature.

Datasheet Danfoss Redia[®] Thermostatic sensors series

Setting the temperature

The required room temperature is set by turning the setting dial. The temperature scales below shows the correlation between scale values and the room temperature. The temperature values stated are for guidance only as the obtained room temperature will often be influenced by installation conditions. Locking and limitation of the temperature set-point of ther Danfoss Redia[®] RA thermostats are carried out using the limiter buttons placed at the side of the sensor.

The procedure is described in the instruction.

Danfoss Redia®



*12|||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||||</

Danfoss Redia® 015G5421



Setting position Image: Setting position</t

✤ = Frost protection setting

Setting position



Danfoss Redia® 015G5422

| Setting | position | | | |
|------------|------------|----------|----|--|
| * | 1 | 2 | 3 | |
| 8 | 12 | 16 | 20 | |
| Room t | emperature | | | |
| . _ | | | | |

✤ = Frost protection setting

Danfoss Redia® 015G5423



| Setting | g position | | | |
|---------------|---------------|------------|----|--|
| * | 1 | 2 | 3 | |
| 8 | 12 | 16 | 20 | |
| Room | temperature | | | |
| ≵ = Fr | ost protectio | on setting | | |

Danfoss Redia[®] 015G3396



Setting position

| setting position | | | | | |
|------------------|----------|----|----|----|----|
| | 2 | 3 | 4 | 5 | |
| | 16 | 20 | 24 | 28 | °C |
| Room temperature | | | | | |

Danfoss Redia® 015G5320



| Setting | position | | | |
|-----------------------|--------------------|------------|------|----|
| * | 1 | 2 | | |
| 7.5 Room te | 11.5 emperature | 15.5 2 | 19.5 | °C |
| ₩ = Fro | st protecti | on setting | g | |

°C

Danfos

Datasheet Danfoss Redia[®] Thermostatic sensors series

Choose the right sensor

The thermostatic sensor should be selected on the basis of the following criteria:

The thermostat must always be able to register the temperature of the ambient air.

Radiator thermostats with built-in sensors

These should always be fitted horizontally so that the ambient air can pass freely over the sensor. Danfoss does not recommend the fitting of a built-in sensor in vertical position because heat effect from the valve body and possibly surface pipes will cause incorrect operation of the thermostat.

Radiator thermostats with remote sensor


- These should be used when:
- Curtains cover the thermostat
- Thermostat is affected by surface pipes
- Thermostat is affected by draught
- It is necessary to mount the thermostat in vertical position if there are adjacent obstructions.

The remote sensor must be mounted on the wall, away from curtains, or on the skirting board beneath the radiator if free of surface pipes.

All remote sensors are now supplied with ultrathin capillary tube. Simply pull out the length required (2 m maximum) and fix using clips provided or a special tacker gun.











35,6

Datasheet [


Danfoss Redia® Thermostatic sensors series


Dimensions


Danfoss Redia® RA with remote sensor


Danfoss Redia® RTD

Danfoss Redia® M30

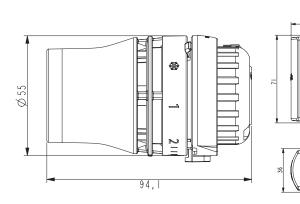







Danfoss Redia® Herz

Climate Solutions • danfoss.com • +45 7488 2222

Any information, including, but not limited to information on selection of product, its application or use, product design, weight, dimensions, capacity or any other technical data in product metalogues descriptions, advertisements, etc. and whether made available in writing, orally, electronically, online or via download, shall be considered informative, and is only binding if and to extent, explicit reference is made in a quotation or order confirmation. Danfoss cannot accept any responsibility for possible errors in catalogues, brochures, videos and other material. Danfoss reserves the right to alter its products without notice. This also applies to products ordered but not delivered provided that such alterations can be made without changes to form, fit o function of the product. All trademarks in this material are property of Danfoss A/S or Danfoss group companies. Danfoss and the Danfoss logo are trademarks of Danfoss A/S. All rights reserved.